SUNLINE 2000™ GAS / ELECTRIC SINGLE PACKAGE AIR CONDITIONERS

INSTALLATION INSTRUCTION | Supersedes: 530.18-N6Y (1298) | 530.18-N6Y (500)

035-12552

MODELS D2CG180 & 240 (STY. B) (8.4 - 8.5 EER)

208/230/460 VOLT ONLY

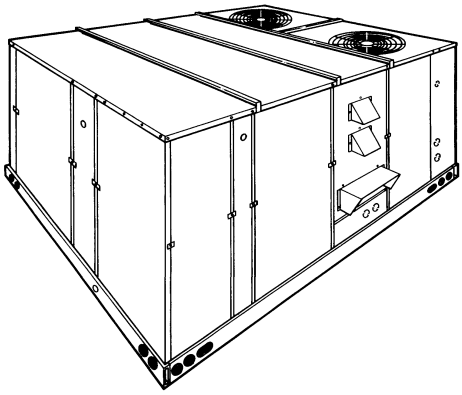

208/230/575 VOLT ONLY

ISO 9001 CERTIFIED

SAFETY CONSIDERATIONS

Due to system pressure, moving parts and electrical components, installation and servicing of air conditioning equipment can be hazardous. Only qualified, trained, service personnel should install, repair, maintain or service this equipment.

Observe all precautions in the literature, on labels and tags accompanying the equipment whenever working on air conditioning equipment. Be sure to follow all other safety precautions that apply.

Wear safety glasses and work gloves, and follow all safety codes. Use a quenching cloth and have a fire extinguisher available for all brazing operations.

GENERAL

YORK Model DCG units are single package gas-fired central heating furnaces with cooling unit designed for outdoor installation on a rooftop or a slab.

The units are completely assembled on rigid, permanently attached base rails. All piping, refrigerant charge, and electrical wiring is factory installed and tested. The units require electric power, gas connection, duct connections, installation of combustion air inlet hood, flue gas outlet hoods and fixed outdoor air intake damper (units without economizer or motorized damper option only) at the point of installation.

FOR YOUR SAFETY

If you smell gas:

1. Open windows.
2. Don't touch electrical switches; do not use any phones in the area of the gas leak.
3. Extinguish any open flame.
4. Immediately call your gas supplier from another location. Follow your gas supplier's instructions.
5. If you cannot reach your gas supplier, call the fire department.

FOR YOUR SAFETY

Do not store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance**.**

The gas-fired heaters have aluminized-steel tubular heat exchangers and spark ignition with proven pilot.

INSPECTION

As soon as a unit is received, it should be inspected for possible damage during transit. If damage is evident, the extent of the damage should be noted on the carrier's freight bill. A separate request for inspection by the carrier's agent should be made in writing. Refer to Form 50.15-NM for additional information.

REFERENCE

Additional information on the design, installation, operation and service of this equipment is available in the following reference forms:

- 44-320-10 - Barometric Relief Damper Accessory
- 530.18-N6.1V - Propane Conversion Accessory (USA)
- 530.18-N6.2V - High Altitude Accessory (Nat. Gas)
- 530.18-N6.3V - High Altitude Accessory (Propane)
- 530.18-N13Y - Coil Guard Installation

Renewal Parts:

- Refer to the Renewal Parts Manual for complete listing of replacement parts on this equipment.

All forms referenced in this instruction may be ordered from:

Standard Register
2101 West Tecumeseh Road
Norman, Oklahoma 73069
Toll Free Fax: (877) 379-7920
Toll Free Phone: (877) 318-9675

APPROVALS

Design certified by ETL & CGA as follows:

1. For use as a forced air furnace with cooling unit.
2. For outdoor installation only.
3. For installation on combustible material.
4. For use with natural gas or propane gas.

CAUTION

THIS PRODUCT MUST BE INSTALLED IN STRICT COMPLIANCE WITH THE ENCLOSED INSTALLATION INSTRUCTIONS AND ANY APPLICABLE LOCAL, STATE, AND NATIONAL CODES INCLUDING, BUT NOT LIMITED TO, BUILDING, ELECTRICAL, AND MECHANICAL CODES.

WARNING

INCORRECT INSTALLATION MAY CREATE A CONDITION WHERE THE OPERATION OF THE PRODUCT COULD CAUSE PERSONAL INJURY OR PROPERTY DAMAGE

Installer should pay particular attention to the words: *NOTE, CAUTION* and *WARNING*. Notes are intended to clarify or make the installation easier. Cautions are given to prevent equipment damage. Warnings are given to alert installer that personal injury and/or equipment damage may result if installation procedure is not handled properly.

TABLE OF CONTENTS

General 1
Inspection 1
Reference 1
Approvals 1
Nomenclature 2

INSTALLATION

Limitations 3
Location 3
Rigging and Handling 3
Clearances 3
Ductwork 3
Fixed Outdoor Air Intake Damper 4
Condensate Drain 4
Compressors 4
Filters 4
Service Access 4
Thermostat 5
Power and Control Wiring 5
Combustion Discharge 5
Gas Piping 5
Gas Connection 6
L.P. Units, Tanks and Piping 6
Vent and Combustion Air Hoods 6
Optional Economizer/Mot. Damper Rain Hood 7
Optional Power Exhaust Rain Hood 9

OPERATION

Cooling System 15
Preliminary Operation Cooling 15
Cooling Sequence of Operation 15
Safety Controls (Cooling) 15
Heating System 15
Safety Controls (Heating) 16
Heat Anticipator Setpoints 16
Pre-Start Check List 16

START-UP

Operating Instructions 17
Post-Start Check List 17
Manifold Gas Pressure Adjustment 17
Pilot Checkout 17
Burner Instructions 17
Burner Air Shutter Adjustment 18
Checking Supply Air CFM 18
Adjustment of Temperature Rise 19
Checking Gas Input 19
Secure Owner's Approval 19

MAINTENANCE & TROUBLESHOOTING

Normal Maintenance 20
Cleaning Flue Passages and Heating Elements 20
Troubleshooting 21
Replacement Parts 23

TABLES

No.	Description	Page
1	Unit Application Data	3
2	Control Wire Sizes	5
3	Gas Heat Application Data	6
4	Pipe Sizing	6
5	Physical Data	9
6	Electrical Data	10
7	Four And Six Point Loads	12
8	Supply Air Blower Perf. 15 Ton	13
9	Supply Air Blower Perf. 20 Ton	14
10	Static Resistances	15
11	Power Exhaust Performance	15
12	Blower Motor and Drive Data	15
13	Limit Control Setting	17
14	Gas Rate - Cubic Feet Per Hour	20

FIGURES

No.	Description	Page
1	Typical Rigging	3
2	Center of Gravity	3
3	Fixed Outdoor Air Damper Assembly	4
4	Recommended Drain Piping	4
5	Typical Field Wiring	5
6	External Supply Connection	6
7	Bottom Supply Connection	6
8	Vent and Combustion Air Hoods	7
9	Adjusting Enthalpy Setpoint	8
10	Dimensions and Clearances	11
11	Four and Six Point Loads	12
12	Gas Valve Piping	17
13	Gas Valve and Controls	17
14	Typical Gas Valve	18
15	Proper Flame Adjustment	18
16	Typical Flame Appearance	19
17	Belt Adjustment	19
18	Pressure Drop versus Supply Air CFM	19
19	Typical Flue Baffle Installation	21

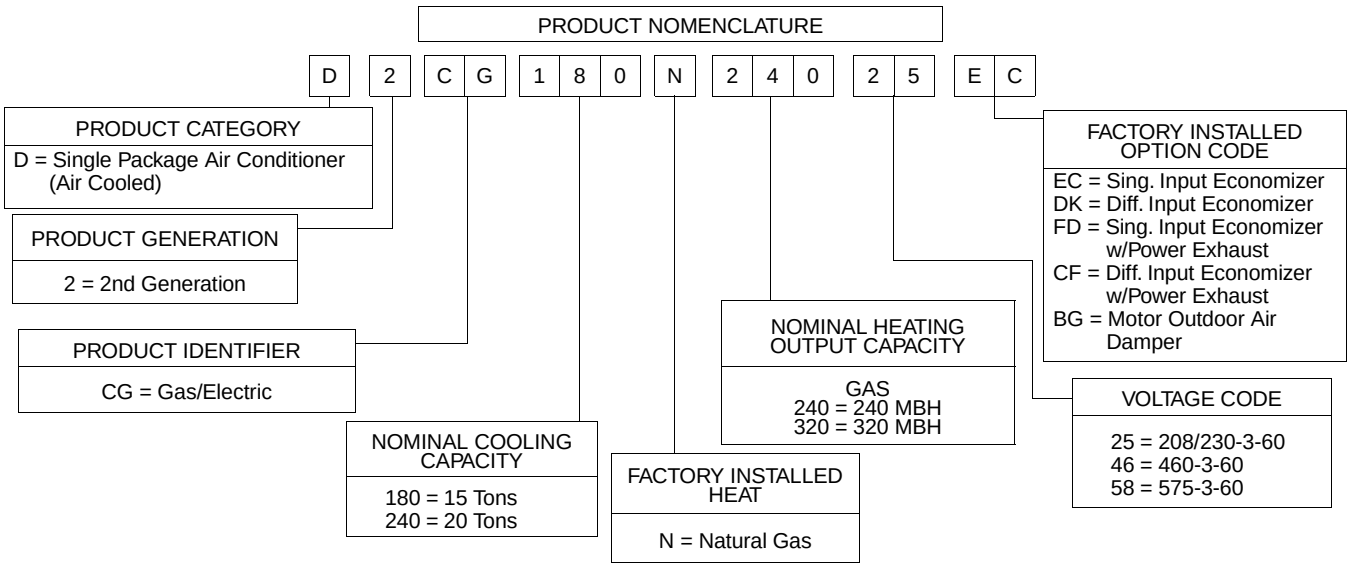
PRODUCT NOMENCLATURE
D 2 C G 1 8 0 N 2 4 0 2 5 E C
PRODUCT CATEGORY
D = Single Package Air Conditioner (Air Cooled)
PRODUCT GENERATION
2 = 2nd Generation
PRODUCT IDENTIFIER
CG = Gas/Electric
NOMINAL COOLING CAPACITY
180 = 15 Tons
240 = 20 Tons
FACTORY INSTALLED HEAT
N = Natural Gas
NOMINAL HEATING OUTPUT CAPACITY
GAS
240 = 240 MBH
320 = 320 MBH
VOLTAGE CODE
25 = 208/230-3-60
46 = 460-3-60
58 = 575-3-60
FACTORY INSTALLED OPTION CODE
EC = Sing. Input Economizer
DK = Diff. Input Economizer
FD = Sing. Input Economizer w/Power Exhaust
CF = Diff. Input Economizer w/Power Exhaust
BG = Motor Outdoor Air Damper

INSTALLATION

LIMITATIONS

These units must be installed in accordance with the following national and local safety codes:

In U.S.A.:

1. National Electrical Code ANSI/NFPA No. 70.
2. National Fuel Gas Code Z223.1.
3. Gas-Fired Central Furnace Standard ANSI Z21.47a.
4. Local gas utility requirements.

In Canada:

1. Current Canadian Electrical Code C22.1.
2. Current Gas Installation Codes CAN/CGA-B149.1 and .2
3. Local plumbing and waste water codes.
4. Other applicable local codes.

Refer to the Unit Application Data table and to the Gas Heat Application Data table.

After installation, the unit must be adjusted to obtain a temperature rise within the range specified on the unit rating plate.

If components are to be added to a unit to meet local codes, they are to be installed at the dealer's and/or the customer's expense.

Size of unit for proposed installation should be based on heat loss/heat gain calculation made according to the methods of the Air Conditioning Contractors of America (ACCA).

This furnace is not to be used for temporary heating of buildings or structures under construction.

TABLE 1 - UNIT APPLICATION DATA

Model Size		15 TON	20 TON
Voltage Variation, Min. / Max.[1]	208/230-3-60	187 / 253	
	460-3-60	414 / 506	
	575-3-60	518 / 630	
Supply Air CFM, Min. / Max.		4500 / 7200	6000 / 9400
Wet Bulb Temperature (°F) of Air on Evaporator Coil, Min. / Max.		57 / 72	
Dry Bulb Temperature (°F) of Air on Condenser Coil, Min.[2] / Max.		25 / 120	

1Utilization range "A" in accordance with ARI Standard 110.
[2]A low ambient accessory is available for operation down to 0°F.

LOCATION

Use the following guidelines to select a suitable location for these units.

1. Unit is designed for outdoor installation only.
2. Condenser coils must have an unlimited supply of air. Where a choice of location is possible, position the unit on either north or east side of building.

WARNING: Excessive exposure of this furnace to contaminated combustion air may result in equipment damage or personal injury. Typical contaminates include: permanent wave solutions, chlorinated waxes and cleaners, chlorine based swimming pool chemicals, water softening chemicals, carbon tetrachloride, Halogen type refrigerants, cleaning solvents (e.g. perchloroethylene), printing inks, paint removers, varnishes, hydrochloric acid, cements and glues, antistatic fabric softeners for clothes dryers, masonry acid washing materials.

3. For ground level installation, use a level concrete slab with a minimum thickness of 4 inches. The length and width should be at least 6 inches greater than the unit base rails. Do not tie slab to the building foundation.
4. Roof structures must be able to support the weight of the unit and its options and/or accessories. Unit must be installed on a solid level roof curb or appropriate angle iron frame.

CAUTION: If a unit is to be installed on a roof curb or special frame other than a YORK roof curb, gasketing must be applied to all surfaces that come in contact with the unit underside.

5. Maintain level tolerance to 1/2 inch maximum across the entire length or width of the unit.

RIGGING AND HANDLING

Exercise care when moving the unit. Do not remove any packaging until the unit is near the place of installation. Rig the unit by attaching chain or cable slings to the round lifting holes provided in the base rails. Spreaders, whose length exceeds the largest dimension across the unit, **MUST** be used across the top of the unit. Refer to the figure below.

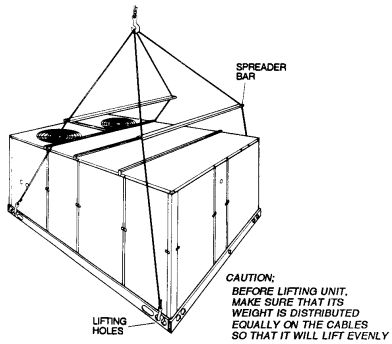
SPREADER BAR
CAUTION:
BEFORE LIFTING UNIT, MAKE SURE THAT ITS WEIGHT IS DISTRIBUTED EQUALLY ON THE CABLES SO THAT IT WILL LIFT EVENLY
LIFTING HOLES

FIG. 1 - TYPICAL RIGGING

CAUTION: Before lifitng a unit, make sure that all panels are in place and that its weight is distrbuted equally on all cables so it will lift evenly.

Units may also be moved or lifted with a forklift, from the front or rear only, providing that an accessory skid is used.

LENGTH OF FORKS MUST BE A MINIMUM OF 90".

CAUTION: An adhesive backed label is provided over the outside of the combustion air inlet opening to prevent moisture from entering the unit which could cause damage to electrical components. Allow this closure label to remain in place until the combustion air hood is to be installed (refer to Vent and Combustion Hood Figure).

Refer to the Physical DataTable for unit weights and to the figure below for approximate center of gravity.

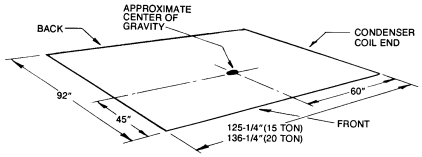

FIG. 2 - CENTER OF GRAVITY

CLEARANCES

All units require certain clearances for proper operation and service. Installer must make provisions for adequate combustion and ventilation air in accordance with Section 5.3, Air for Combustion and Ventilation of the National Fuel Gas Code, ANSI Z223.1 (in U.S.A.) or Sections 7.2, 7.3 or 7.4 of Gas Installation Codes CAN/CGA-B149.1 and .2 (in Canada) and/or applicable provisions of the local building codes. Refer to Dimensions and Clearances Figure for the clearances required for combustible construction, servicing, and proper unit operation.

WARNING: Do not permit overhanging structures or shrubs to obstruct outdoor air discharge outlet, combustion air inlet or vent outlets.

DUCTWORK

Ductwork should be designed and sized according to the methods in Manual Q of the Air Conditioning Contractors of America (ACCA).

A closed return duct system shall be used. This shall not preclude use of economizers or outdoor fresh air intake. The supply and return air duct connections at the unit should be made with flexible joints to minimize noise.

The supply and return air duct systems should be designed for the CFM and static requirements of the job. They should NOT be sized to match the dimensions of the duct connections on the unit.

CAUTION: When fastening ductwork to side duct flanges on unit, insert screws through duct flanges only. DO NOT insert screws through casing.

Outdoor ductwork must be insulated and waterproofed.

Refer to Dimensions and Clearances Figure for information concerning side and bottom supply and return air duct openings.

It is recommended that, in Canada, the outlet duct be provided with a removable access panel. It is recommended that this opening be accessible when the unit is installed in service, and of a size such that smoke or reflected light may be observed inside the casing to indicate the presence of leaks in the heat exchanger. The cover should be attached in a manner adequate to prevent leakage.

FIXED OUTDOOR AIR INTAKE DAMPER

This damper is shipped inside the return air compartment. It is completely assembled and ready for installation. A damper baffle inside of the hood is adjustable to provide variable amounts of outdoor air intake on units that are not provided with an economizer or a motorized damper option. Refer to the Fixed Outdoor Damper figure.

Gasketing and mounting screws are provided in a parts bag attached to the hood assembly. Apply gasketing to the three flange surfaces on the hood prior to installing the hood. Extend gasketing 1/4 inch beyond the top and bottom of the two side flanges to insure adequate sealing.

Adjusting the damper to the desired air flow may be done before mounting the hood into position or (after installation) by removing the front hood panel or the screen on the bottom of the hood. Damper baffle in position 1 will allow approximately 10% recirculated air flow, position 2 approximately 15% and, to allow approximately 25%, remove the damper baffle.

On units with bottom return air applications, install the damper assembly over the opening in the side return air access panel. Remove and discard the opening cover and the covering over the hood mounting holes (used for shipping) before installing. Secure with the screws provided.

On units with side return air applications, install the damper assembly on the return air ductwork as close to the unit as possible. Cut an opening 16 inches high by 18 inches wide in the ductwork to accommodate the damper. Using the holes in the hood flanges as a template, drill 9/64 inch dia. (#26 drill) holes into the ductwork and secure with the screws provided.

CAUTION: If outdoor air intake will not be required on units with bottom return air applications, the damper assembly should still be mounted on the side return air access panel, per the instructions above, to insure moisture is not drawn into the unit during operation. The covering over the mounting holes only need be removed. Do not remove the opening cover.

CONDENSATE DRAIN

Plumbing must conform to local codes. Use a sealing compound on male pipe threads. Install a condensate drain line

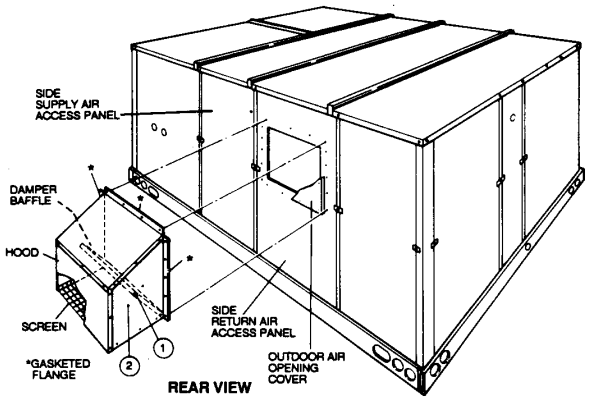

FIG. 3 - FIXED OUTDOOR AIR DAMPER

from the one-inch NPT female connection on the unit to an open drain.

An alternate drain connection (one-inch NPT female coupling) is provided inboard on the same centerline as the exterior location.

NOTE: The condensate drain operates in a negative pressure in the cabinet. The condensate drain line MUST be trapped to provide proper drainage. See figure below.

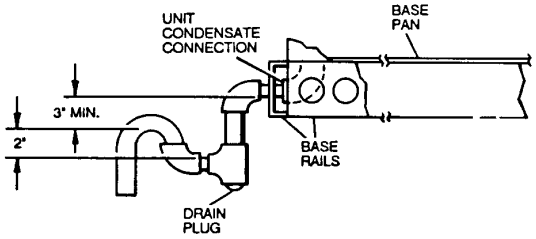

FIG. 4 - RECOMMENDED DRAIN PIPING

COMPRESSORS

Units are shipped with compressor mountings factory-adjusted and ready for operation.

CAUTION: Do Not loosen compressor mounting bolts.

FILTERS

Two-inch filters are supplied with each unit. Filters must always be installed ahead of the evaporator coil and must be kept clean or replaced with same size and type. Dirty filters will reduce the capacity of the unit and will result in frosted coils or safety shutdown. Minimum filter area and required sizes are shown in Physical Data Table.

SERVICE ACCESS

Access to all serviceable components is provided by the following removable panels:

- Compressor compartment
- Gas Heat compartment (Two panels)
- Side Supply & Return Air compartments (Two panels)
- Blower compartment (Three panels)
- Main control box
- Filter compartment
- Outdoor Air compartment (Two panels)

Refer to the Dimensions and Clearances Figure for location of these access panels.

CAUTION: Make sure that all screws and panel latches are replaced and properly positioned on the unit to maintain an air-tight seal.

CONTROL WIRING

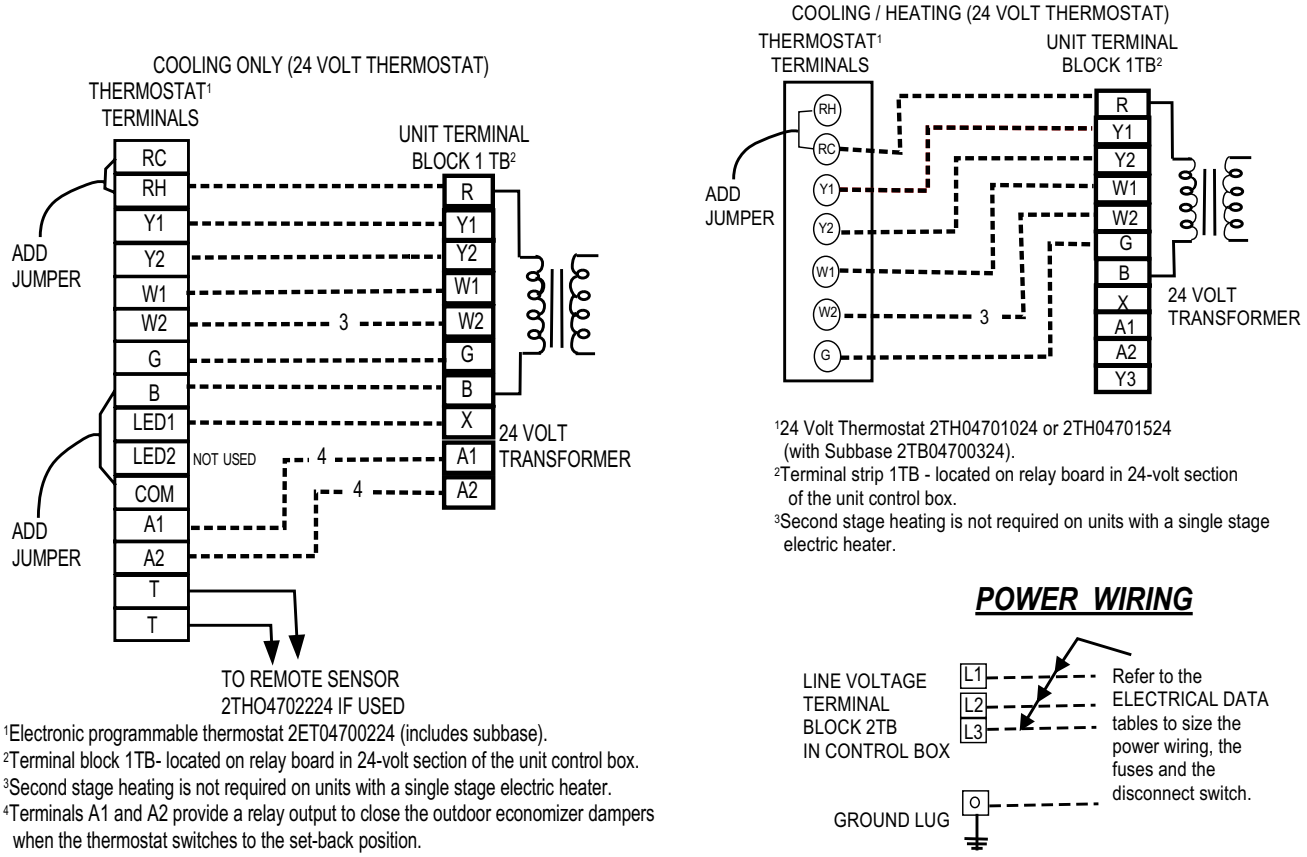

[1]24 Volt Thermostat 2TH04701024 or 2TH04701524 (with Subbase 2TB04700324).
[2]Terminal strip 1TB - located on relay board in 24-volt section of the unit control box.
[3]Second stage heating is not required on units with a single stage electric heater.

POWER WIRING

LINE VOLTAGE TERMINAL BLOCK 2TB IN CONTROL BOX
L1
L2
L3
Refer to the ELECTRICAL DATA tables to size the power wiring, the fuses and the disconnect switch.
GROUND LUG
O

[1]Electronic programmable thermostat 2ET04700224 (includes subbase).
[2]Terminal block 1TB- located on relay board in 24-volt section of the unit control box.
[3]Second stage heating is not required on units with a single stage electric heater.
[4]Terminals A1 and A2 provide a relay output to close the outdoor economizer dampers when the thermostat switches to the set-back position.
NOTE: Fans switch must be in "ON" position for minimum ventilation during heater operation.

FIG. 5 - TYPICAL FIELD WIRING

THERMOSTAT

The room thermostat should be located on an inside wall approximately 56 inches above the floor where it will not be subject to drafts, sun exposure or heat from electrical fixtures or appliances. Follow manufacturer's instructions enclosed with thermostat for general installation procedure. Seven color coded insulated wires (#18 AWG) should be used to connect thermostat to unit.

POWER AND CONTROL WIRING

Field wiring to the unit must conform to provisions of the National Electrical Code, ANSI / NFPA No. 70 (in U.S.A.), current Canadian Electrical Code C22.1 (in Canada) and/or local ordinances. The unit must be electrically grounded in accordance with NEC and CEC (as specified above) and/or local codes. Voltage tolerances which must be maintained at the compressor terminals during starting and running conditions are indicated on the unit Rating Plate and the Unit Application Data table.

The internal wiring harness furnished with this unit is an integral part of a ETL and CGA design certified unit. Field alteration to comply with electrical codes should not be required.

A fused disconnect switch should be field provided for the unit. The switch must be separate from all other circuits. Wire entry at knockout openings require conduit fittings to comply with NEC (in U.S.A.), CEC (in Canada) and/or local codes. Refer to the Dimensions and Clearnaces Figure for installation location. If any of the wire supplied with the unit must be replaced, replacement wire must be of the type shown on the wiring diagram and the same minimum gauge as the replaced wire.

Electrical line must be sized properly to carry the load. Use copperconductors only. Each unit must be wired with a separate branch circuit fed directly from the meter panel and properly fused.

CAUTION: When connecting electrical power and control wiring to the unit, waterproof type connectors MUST BE USED so that water or moisture cannot be drawn into the unit during normal operation. The above waterproofing conditions will also apply when installing a field-supplied disconnect switch.

Refer to the Typical Field Wiring figure and to the appropriate unit wiring diagram for control circuit and power wiring information.

TABLE 2 - CONTROL WIRE SIZES

Wire Size[1] AWG. Gauge				
22	20	19	18	16
40	120	150	190	305
Maximum Wire Length[2] Feet				

Notes:
1. Solid, Class II copper wire
2. Based on a voltage drop of 1.2 volts per wire.
3. Total wire length is from unit to room thermostat, and back to unit

TABLE 3 - GAS HEAT APPLICATION DATA

Input Capacity (Mbh)				Output Capacity (Mbh)		Available on Models	Gas Rate[2] (Ft.[3]/Hr.)	Temp. Rise °F At Full Input [3]	
0 To 2,000 Feet Above Sea Level		2,000 To 4,500 Feet Above Sea Level[1]		0 To 2,000 Feet Above Sea Level	2,000 To 4,500 Feet Above Sea Level[1]				
Max.	Min.	Max.	Min.	Max.	Max.			Min.	Max.
300	150	270	135	240	213	15 & 20 Ton	279	20	50
400	200	360	180	320	281	15 & 20 Ton	372	30	60

NOTE: Heaters are shipped available for natural gas, but can be converted to L.P. / Propane with Kit Model No. 1NP0418.
[1]MBH rating should be reduced at the rate of 4 percent for each 1,000 feet above 4,500 feet.
[2]Based on maximum input and 1075 Btu/Ft[3].
[3]The air flow must be adjusted to obtain a temperature rise within the range shown.

COMBUSTION DISCHARGE

The products of combustion are discharged horizontally through two screened (hooded) openings on the upper gas heat access panel.

GAS PIPING

Proper sizing of gas piping depends on the cubic feet per hour of gas flow required, specific gravity of the gas and the length of run. "National Fuel Gas Code" Z223.1 (in U.S.A.) or the current Gas Installation Codes CAN/CGA-B149.1 and .2 (in Canada) should be followed in all cases unless superseded by local codes or gas utility requirements. Refer to the Pipe Sizing table.

The heating value of the gas may differ with locality. The value should be checked with the local gas utility.

NOTE: There may be a local gas utility requirement specifying a minimum diameter for gas piping. All units require a one-inch pipe connection at the entrance fitting.

TABLE 4 - PIPE SIZING

Length in Feet	Nominal Iron Pipe Size	
	1 in.	1-1/4 in.
10	520	1,050
20	350	730
30	285	590
40	245	500
50	215	440
60	195	400
70	180	370
80	170	350
90	160	320
100	150	305

Maximum capacity of pipe in cubic feet of gas per hour. (Based upon a pressure drop of 0.3 inch water column and 0.6 specific gravity gas).

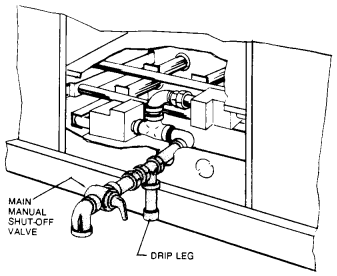

FIG. 6 - EXTERNAL SUPPLY CONNECTION EXTERNAL SHUT-OFF

GAS CONNECTION

The gas supply line can be routed through the knockouts located on the front of the unit or through the opening provided in the unit's base. Refer to the Dimensions and Clearances figure to locate these access openings. Typical supply piping arrangements are shown in the figures on this page. All shaded items are field-supplied.

If gas supply line is routed through the unit's base ensure that the burner assembly can be removed for maintenance without disturbing the supply line. The supply piping and fittings must lie below the bottom gas manifold to avoid interference with the burner assembly.

Two grommets are shipped in the blower compartment (in parts bag taped to the blower housing) of every unit with gas heat and should be used in the knockouts when the gas piping penetrates the front of the unit.

After the gas supply piping has been installed, the bottom opening in the unit should be sealed to prevent water from leaking into the building.

Gas piping recommendations:

1. A drip leg and a ground joint union must be installed in the gas piping.
2. When required by local codes, a manual shut-off valve may have to be installed outside of the unit.
3. Use wrought iron or steel pipe for all gas lines. Pipe compound should be applied sparingly to male threads only.

WARNING: Natural gas may contain some propane. Propane, being an excellent solvent, will quickly dissolve white lead or most standard commercial compounds. Therefore, a special pipe compound must be applied when wrought iron or steel pipe is used. Shellac base compounds such as Gaskolac or Stalastic, and compounds such as Rectorseal #5, Cyde's or John Crane may be used.

4. All piping should be cleaned of dirt and scale by hammering on the outside of the pipe and blowing out the loose dirt and scale. Before initial start-up, be sure that all of the gas lines external to the unit have been purged of air.
5. The gas supply should be a separate line and installed in accordance with all safety codes as prescribed under "Limitations". After the gas connections have been completed, open the main shut-off valve admitting *normal gas pressure* to the mains. Check all joints for leaks with soap solution or other material suitable for the purpose. NEVER USE A FLAME.
6. The furnace and its individual manual shut-off valve must be disconnected from the gas supply piping system during any pressure testing of that system at test pressures in excess of 1/2 psig (3.48kPa).

   The furnace must be isolated from the gas supply piping system by closing its individual manual shut-off valve during any pressure testing of the gas supply piping system at test pressures equal to or less than 1/2 psig (3.48kPa).
7. A 1/8 inch NPT plugged tapping, accessible for test gage connection, must be installed immediately upstream of the gas supply connection to the furnace.

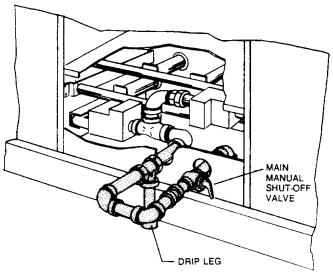

FIG. 7 - BOTTOM SUPPLY CONNECTION EXTERNAL SHUT-OFF

L.P. UNITS, TANKS AND PIPING

All gas heat units are shipped from the factory equipped for natural gas use only. The unit may be converted in the field for use with L.P./propane gas with accessory kit model number 1NP0418.

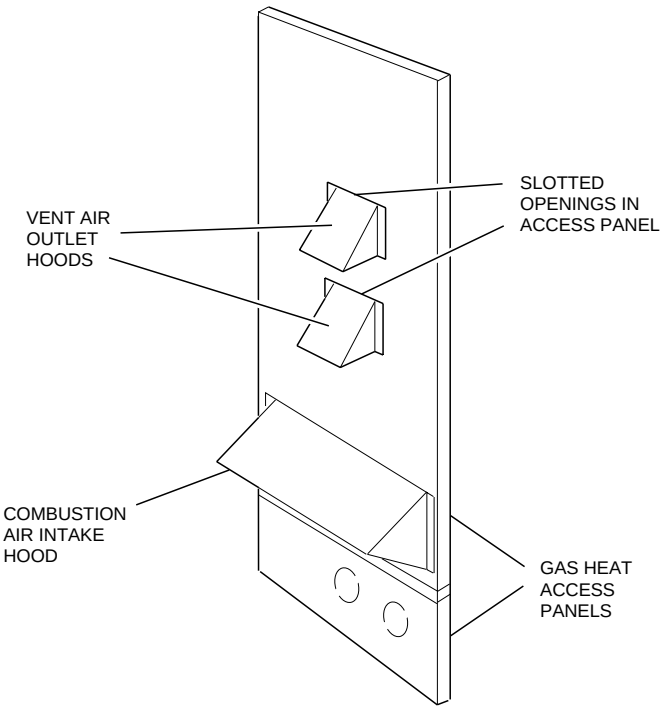

FIG. 8 - VENT AND COMBUSTION AIR HOODS

All L.P./propane gas equipment must conform to the safety standards of the National Fire Protection Association.

For satisfactory operation, L.P./propane gas pressure must be 8.8 inch W.C at the unit under full load. Maintaining proper gas pressure depends on three main factors:

1. The vaporization rate which depends on (a) the temperature of the liquid and (b) the "wetted surface" area of the container or containers.
2. The proper pressure regulation. (Two-stage regulation is recommended from the standpoint of both cost and efficiency.)
3. The pressure drop in the lines between regulators and between the second stage regulator and the appliance. Pipe size required will depend on the length of the pipe run and the total load of all appliances.

Complete information regarding tank sizing for vaporization, recommended regulator settings, and pipe sizing is available from most regulator manufacturers and L.P./propane gas suppliers.

L.P./propane gas is an excellent solvent and special pipe compound must be used when assembling piping for this gas as it will quickly dissolve white lead or most standard commercial compounds. Shellac base compounds such as Rectorseal #5 are satisfactory for this type of gas.

Check all connections for leaks when piping is completed, using a soap solution. NEVER USE A FLAME.

VENT AND COMBUSTION AIR HOODS

Two vent hoods and a combustion air hood (with screens) are shipped attached to the blower housing in the blower compartment. These hoods must be installed to assure proper unit function. All hoods must be fastened to the outside of the gas heat access panel with the screws provided in the bag also attached to the blower housing.

The screen for the combustion air intake hood is secured to the inside of the access panel opening with four fasteners and the screws used for mounting the hood to the panel. The top flange of this hood slips in under the top of the access panel opening when installing. Refer to Vent and Combustion Air Hood figure.

Each vent hood is installed by inserting the top flange of the hood into the slotted opening in the access panel and securing in place.

OPTIONAL ECONOMIZER/MOTORIZED DAMPER RAIN HOOD

The instruction for the optional economizer/motorized damper rain hood can be found in form 44-320-2. Use these instructions when field assembling an economizer rain hood onto a unit. The outdoor and return air dampers, the damper actuator, the damper linkage, the outdoor and return air divider baffles, and all the control sensors are factory mounted as part of the "Factory installed" economizer option.

ENTHALPY SET POINT ADJUSTMENT

Remove the economizer access panel from the unit to check the following adjustments. Loosen but do not remove the two panel latches.

CAUTION: Extreme care must be exercised in turning both the setpoint and minimum position adjusting screws to prevent twisting them off.

6. The enthalpy set point may now be set by selecting the desired setpoint shown in the Adjsuting Enthalpy Setpoint figure. Adjust as follows:
   - For a single enthalpy operation, carefully turn the set point adjusting screw to the "A", "B", "C" or "D" setting corresponding to the lettered curve.
   - For a dual enthalpy operation, carefully turn the set point adjusting screw fully clockwise past the "D" setting.
7. To check that the damper blades move smoothly without binding, carefully turn the minimum position adjusting screw fully clockwise and then energize and de-energize terminals "R" to "G". With terminals "R" to "G" energized, turn the minimum position screw counterclockwise until the desired minimum position has been attained.
8. Replace the economizer access panel. Reposition the two latches horizontally and retighten the screws.

POWER EXHAUST/BAROMETRIC RELIEF DAMPER AND RAIN HOOD OPTION

The instructions for the power exhaust/barometric relief damper and rain hood can be found in form 44-320-10. The exhaust fan, all supporting brackets, angles, and the wiring are factory installed as part of the power exhaust option.

All of the components, including the dampers, hardware, and mounting instructions are shipped in a single package external from the unit. The hood must be field assembled and installed.

Power exhaust is not available as a field installed option.

CONTROL CURVE	CONTROL POINT (APPROX. DEG.) AT 50% RH
A	73 [23]
B	70 [21]
C	67 [19]
D	63 [17]

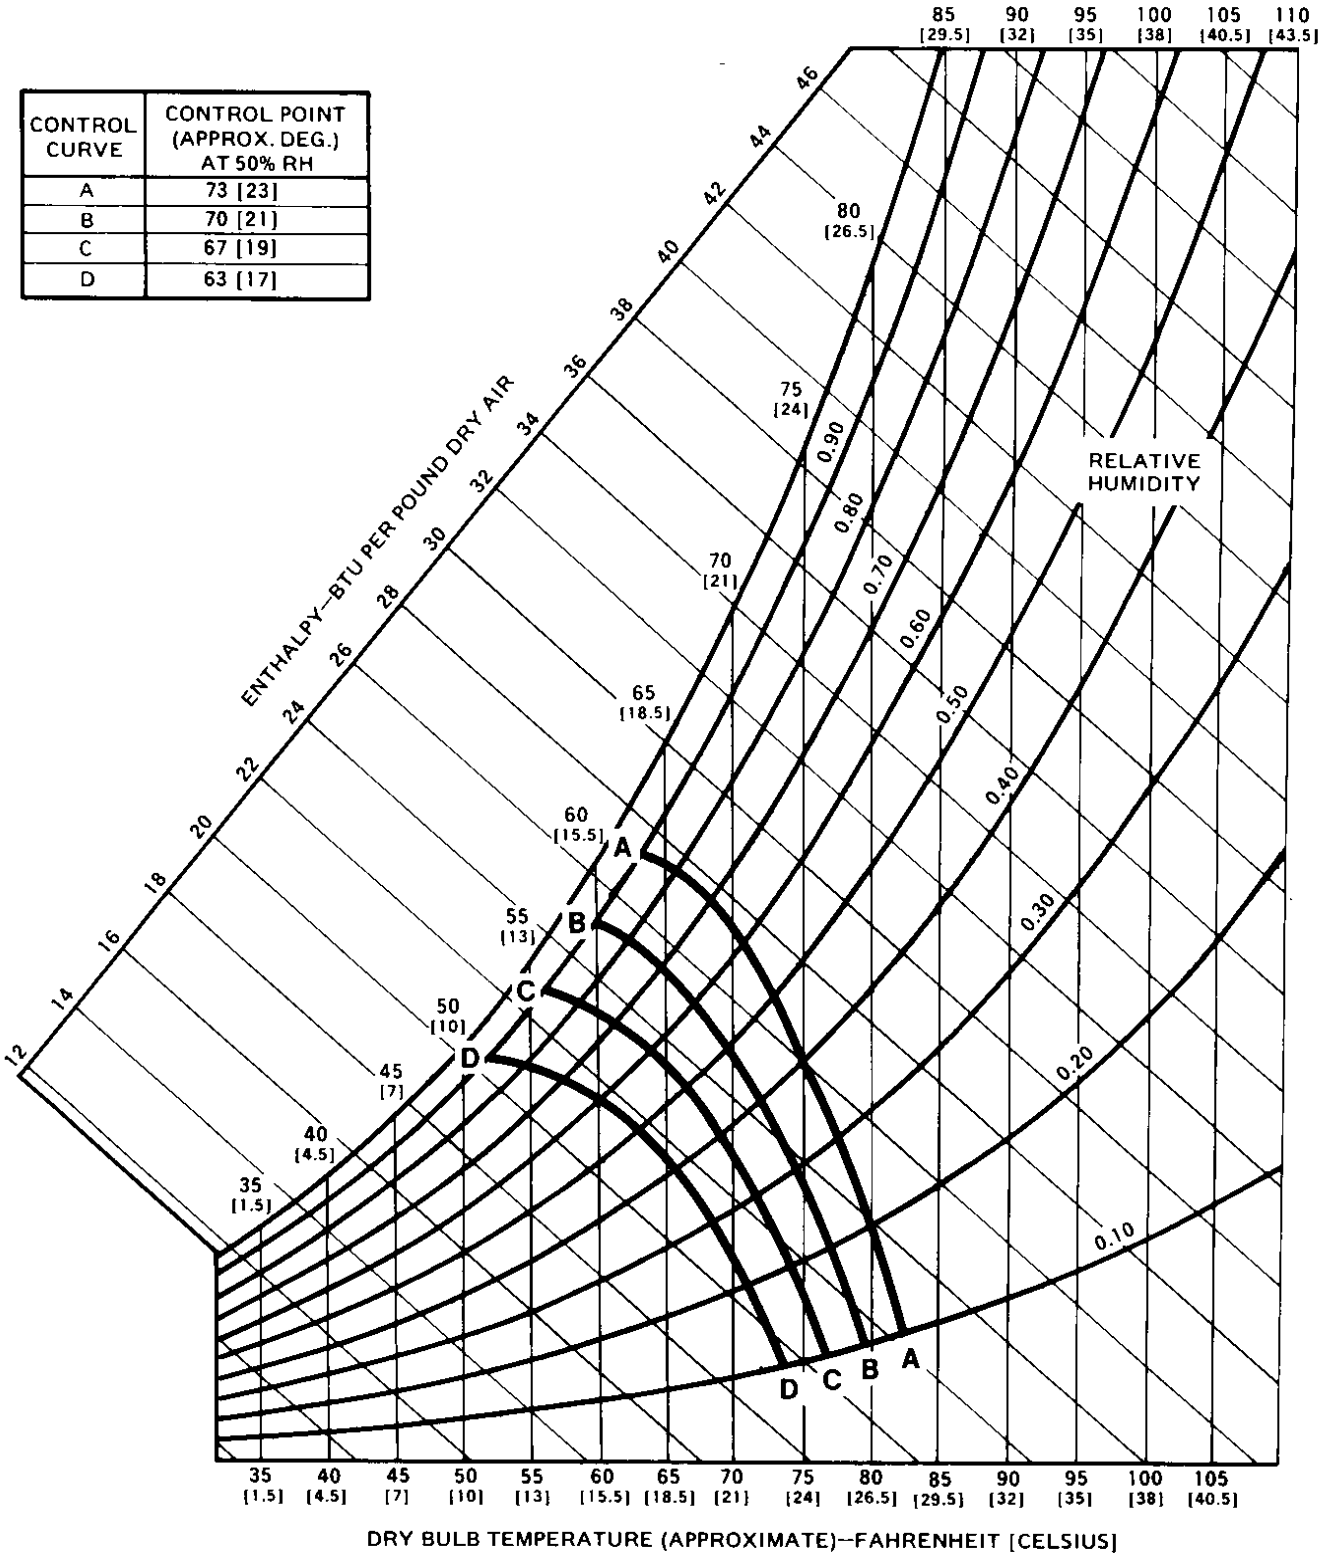

FIG. 9 - ENTHALPY SETPOINT ADJUSTMENT

TABLE 5 - PHYSICAL DATA

MODELS			UNIT SIZE 15 TON	UNIT SIZE 20 TON
EVAPORATOR BLOWER	CENTRIFUGAL BLOWER (Dia. x Wd. in.)		15 x 15	18 x 15
	FAN MOTOR HP		5	7.5
EVAPORATOR COIL	ROWS DEEP		3	3
	FINS PER INCH		13.5	13.5
	FACE AREA (Sq. Ft.)		15.5	20.0
CONDENSER FAN (Two Per Unit)	PROPELLER DIA. (in.)	(Each)	30	30
	FAN MOTOR HP	(Each)	1	1
	NOM. CFM TOTAL	(Each)	6500	7200
CONDENSER COIL	ROWS DEEP		2	2
	FINS PER INCH		13	20
	FACE AREA (Sq. Ft.)		36.0	43.3
COMPRESSOR (Qty. Per Unit)	10-TON TANDEM		1*	2
	5-TON HERMETIC		1	-
AIR FILTERS	QUANTITY PER UNIT (16" X 20" X 2")		-	4
	QUANTITY PER UNIT (16" X 25" X 2")		-	4
	QUANTITY PER UNIT (18" X 24" X 2")		5	-
	TOTAL FACE AREA (sq. ft.)		15.0	20.0
CHARGE	REFRIGERANT 22 (lbs./oz.)	SYSTEM NO. 1	17/8	18/0
		SYSTEM NO. 2	8/8	18/0

*This compressor will be energized first.

OPERATING WEIGHTS (LBS.)		15 TON	20 TON
Basic Unit	240 Mbh	2100	2300
	320 Mbh	2140	2340
Options	Economizer	160	
	Economizer with Power Exhaust	245	
	Motorized Damper	150	
Accessories	Roof Curb	175	185
	Barometric Damper	45	45
	Wood Skid	200	220

TABLE 6 - ELECTRICAL DATA

MODEL	POWER SUPPLY	COMPRESSORS				COND. FAN MOTORS (#1 & #2)		SUPPLY AIR BLOWER MOTOR		MINIMUM CIRCUIT AMPACITY (AMPS)	MAXIMUM TIME DELAY FUSE SIZE (AMPS)
		#1		#2							
		RLA	LRA	RLA	LRA	HP EACH	FLA EACH	HP	FLA		
DCG180	208/230-3-60	38.4	248	19.2	124	1	4.1 / 4.2	5	15.4 / 14.4	87.1 / 84.9	100
	460-3-60	19.2	124	9.6	62	1	2.1	5	7.2	42.4	50
	575-3-60	15.4	100	7.7	50	1	2.0	5	5.9	33.9	40
DCG240	208/230-3-60	38.4	248	38.4	248	1	4.1 / 4.2	7.5	21.0 / 19.4	115.1 / 111.6	125
	460-3-60	19.2	124	19.2	124	1	2.1	7.5	9.7	55.8	60
	575-3-60	15.4	100	15.4	100	1	2.0	7.5	7.8	44.8	50

	POWER SUPPLY	VOLTAGE	
		MIN.	MAX.
VOLTAGE LIMITATIONS**	208/230-3-60	187	253
	460-3-60	414	506
	575-3-60	518	630

**Utilization Range “A” in accordance with ARI Standard 110.

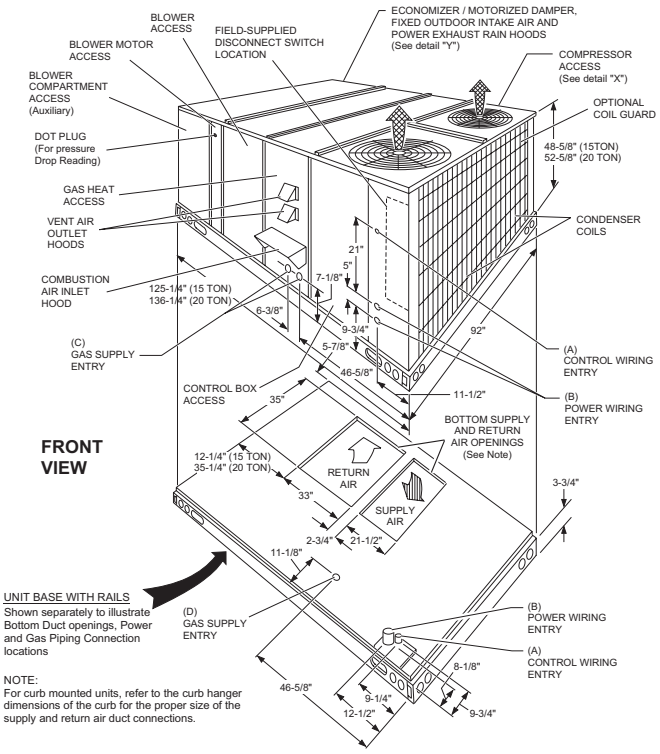



All dimensions are in inches. They are subject to change without notice. Certified dimensions will be provided upon request.

UTILITIES ENTRY DATA

HOLE	OPENING SIZE (DIA.)	USED FOR	
A	1-1/8" KO	Control Wiring	Front
	3/4" NPS (Fem.)		Bottom
B	3-5/8" KO	Power Wiring	Front
	3" NPS (Fem.)		Bottom
C	2-3/8" KO	Gas Piping (Front)	
D	1-11/16" Hole	Gas Piping (Bottom)*	

*Opening in the bottom of the unit can be located by the slice in the insulation.

DUCT COVERS - Units are shipped with the bottom duct openings covered. An accessory flange kit is available for connecting side ducts.

For bottom duct applications:

1. Remove the side panels from the supply and return air compartments to gain access to the bottom supply and return air duct covers.
2. Remove and discard the bottom duct covers. (Duct openings are closed with sheet metal covers except when the unit includes a power exhaust option. The covering consists of a heavy black paper composition.)
3. Replace the side supply and return air compartment panels.

For side duct applications;

1. Replace the side panels on the supply and return air compartments with the accessory flange kit panels.
2. Connect ductwork to the duct flanges on the rear of the unit.

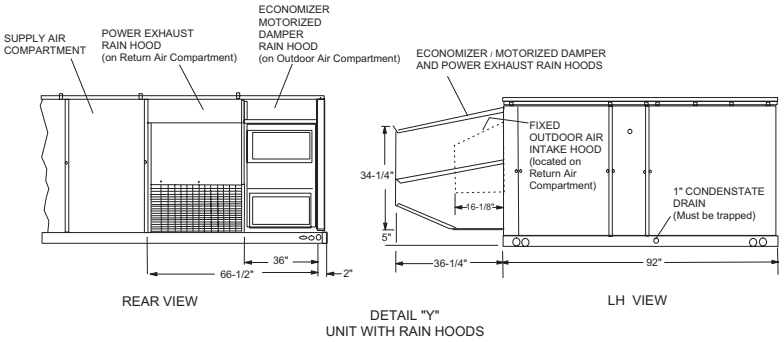

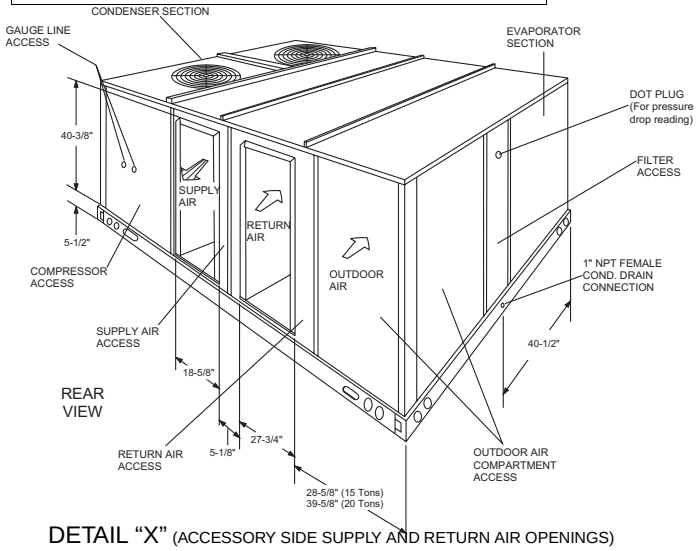

DETAIL "X" (ACCESSORY SIDE SUPPLY AND RETURN AIR OPENINGS)

FIG. 10 - DIMENSIONS & CLEARANCES - 15 & 20 TON

CLEARANCES

Front	36"
Back	24" (Less Economizer) 49" (With Economizer)
Left Side (Filter Access)	24" (Less Economizer) 36"[3] (With Economizer)
Right Side (Cond. Coil)	36"
Below Unit[1]	0"
Above Unit[2]	72" With 36" Maximum Horizontal Overhang (For Condenser Air Discharge Outlet)

1Units (applicable in U.S.A. only) may be installed on combustible floors made from wood or class A, B or C roof covering material.

[2]Units must be installed oudoors. Overhanging structures or shrubs should not obstruct condenser air discharge outlet.

[3] If economizer is factory installed, the assembled hood kit must be removed prior to final installation. This hood is 54" long.

NOTE:
A one-inch clearance must be provided between any combustible material and the supply air ductwork for a distance of 3 feet from the unit.

The products of combustion must not be allowed to accumulate within a confined space and recirculate.

Locate unit so that the vent air outlet hoods are at least:

- Three (3) feet above any forced air inlet located within 10 horizontal feet (excluding those integral to the unit).
- Four (4) feet below, 4 horizontal feet from, or 1 foot above any door or gravity air inlet into the building.
- Four (4) feet from electric meters, gas meters, regulators and relief equip-

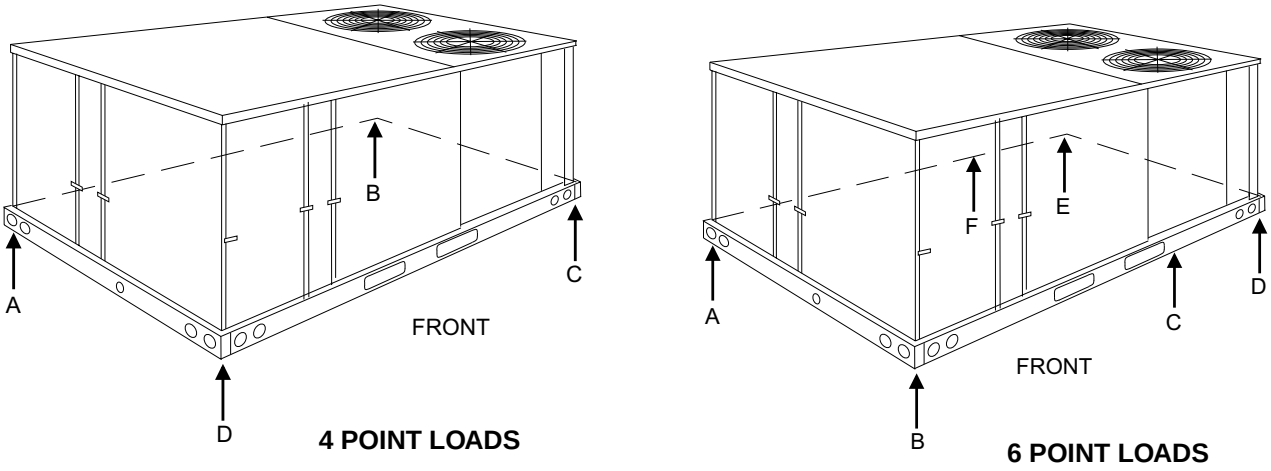

FIG. 11 - FOUR AND SIX POINT LOADS

TABLE 7 - FOUR AND SIX POINT LOADS

UNIT	4 - POINT LOADS (LBS)				
	TOTAL	A	B	C	D
180	2300	539	563	612	586
240	2500	538	563	715	684

NOTE: These weights are with economizer, and the largest blower motor available.

UNIT	6 - POINT LOADS (LBS)						
	TOTAL	A	B	C	D	E	F
180	2300	351	367	392	416	399	375
240	2500	334	350	426	502	481	407

NOTE: These weights are with economizer and the largest blower motor available.

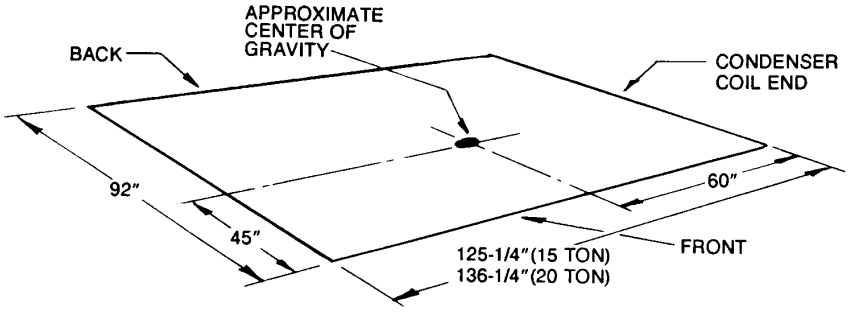

CENTER OF GRAVITY

TABLE 8 - SUPPLY AIR BLOWER PERFORMANCE (15 TON)

DCG180 - BOTTOM DUCT CONNECTIONS

BLOWER SPEED, (RPM)	MOTOR PULLEY (TURNS OPEN)*	CFM														
		4500			5250			6000			6750			7200		
		ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW
208 VOLT AND STANDARD DRIVE																
850	6.0**	0.9	2.4	2.1	0.6	2.9	2.6	0.3	3.4	3.0	-	-	-	-	-	-
870	5.5	1.0	2.5	2.2	0.7	3.0	2.7	0.4	3.5	3.1	-	-	-	-	-	-
915	4.5	1.1	2.6	2.4	0.8	3.1	2.8	0.5	3.6	3.2	0.2	4.1	3.7	-	-	-
965	3.5	1.2	2.7	2.5	0.9	3.2	2.9	0.6	3.7	3.3	0.4	4.4	3.9	0.2	5.0	4.5
980	3.0	1.3	2.9	2.6	1.0	3.4	3.0	0.7	3.8	3.4	0.5	4.5	4.0	0.3	5.1	4.6
1010	2.0	1.4	3.0	2.7	1.1	3.6	3.2	0.8	4.0	3.6	0.6	4.7	4.2	0.4	5.4	4.8
1040	1.0	1.6	3.2	2.9	1.3	3.8	3.4	1.0	4.4	3.9	0.8	5.0	4.5	0.6	5.6	5.0
208 VOLT AND HIGH SPEED DRIVE ACCESSORY																
965	6.0	1.2	2.7	2.5	0.9	3.2	2.9	0.6	3.7	3.3	0.4	4.4	3.9	0.2	5.0	4.5
980	5.5	1.3	2.9	2.6	1.0	3.4	3.0	0.7	3.8	3.4	0.5	4.5	4.0	0.3	5.1	4.6
1025	4.5	1.4	3.1	2.8	1.2	3.6	3.2	0.9	4.1	3.7	0.7	4.8	4.3	0.4	5.5	4.9
1065	3.5	1.6	3.4	3.0	1.4	3.9	3.5	1.1	4.5	4.0	0.9	5.1	4.6	-	-	-
1125	2.0	1.9	3.6	3.2	1.7	4.4	3.9	1.4	5.0	4.5	1.2	5.8	5.2	-	-	-
1170	1.0	2.1	3.9	3.5	1.9	4.7	4.2	1.6	5.5	4.9	-	-	-	-	-	-
230/460 VOLT AND STANDARD DRIVE																
870	6.0**	1.0	2.5	2.2	0.7	3.0	2.7	0.4	3.5	3.1	-	-	-	-	-	-
915	5.0	1.1	2.6	2.4	0.8	3.1	2.8	0.5	3.6	3.2	0.2	4.1	3.7	-	-	-
965	4.0	1.2	2.7	2.5	0.9	3.2	2.9	0.6	3.7	3.3	0.4	4.4	3.9	0.2	5.0	4.5
980	3.5	1.3	2.9	2.6	1.0	3.4	3.0	0.7	3.8	3.4	0.5	4.5	4.0	0.3	5.1	4.6
1015	2.5	1.4	3.0	2.7	1.1	3.6	3.2	0.8	4.0	3.6	0.6	4.7	4.2	0.4	5.4	4.8
1050	1.5	1.5	3.1	2.8	1.2	3.7	3.3	0.9	4.2	3.8	0.7	4.9	4.4	0.5	5.7	5.1
1065	1.0	1.6	3.4	3.0	1.4	3.9	3.5	1.1	4.5	4.0	0.9	5.1	4.6	-	-	-
230/460 VOLT AND HIGH SPEED DRIVE ACCESSORY																
980	6.0	1.3	2.9	2.6	1.0	3.4	3.0	0.7	3.8	3.4	0.5	4.5	4.0	0.3	5.1	4.6
1045	4.5	1.6	3.2	2.9	1.3	3.8	3.4	1.0	4.4	3.9	0.8	5.0	4.5	0.6	5.6	5.0
1065	4.0	1.7	3.4	3.0	1.4	3.9	3.5	1.1	4.5	4.0	0.9	5.1	4.6	-	-	-
1125	2.5	1.9	3.6	3.2	1.7	4.4	3.9	1.4	5.0	4.5	1.2	5.8	5.2	-	-	-
1170	1.5	2.1	3.9	3.5	1.8	4.7	4.2	1.6	5.5	4.9	-	-	-	-	-	-
1190	1.0	2.2	4.0	3.6	1.9	4.8	4.3	1.7	5.6	5.0	-	-	-	-	-	-

NOTES: 1. Blower performance includes a gas-fired heat exchanger, fixed outdoor air, two-inch T/A filters and a dry evaporator coil.

2. Refer to the additional Static Resistances table.

ESP = External Static Pressure available for the supply and return air duct system. All internal unit resistances have been deducted from the total static pressure of the blower.

* Do NOT close the pulley below 1 turn open.

** Factory setting.

TABLE 9 - SUPPLY AIR BLOWER PERFORMANCE (20 TON)

DCG240 - BOTTOM DUCT CONNECTIONS

BLOWER SPEED, (RPM)	MOTOR PULLEY (TURNS OPEN)*	CFM														
		6000			7000			8000			9000			9400		
		ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW	ESP	BHP	KW
208 VOLT AND STANDARD DRIVE																
870	6.0**	1.3	3.6	3.0	0.7	4.3	3.7	0.2	5.1	4.3	-	-	-	-	-	-
900	5.0	1.4	3.8	3.2	0.9	4.7	4.0	0.4	5.6	4.7	-	-	-	-	-	-
930	4.0	1.6	4.1	3.4	1.1	5.0	4.2	0.6	5.9	5.0	0.1	6.7	5.7	-	-	-
950	3.0	1.7	4.2	3.6	1.3	5.1	4.3	0.8	6.0	5.1	0.2	6.9	5.8	-	-	-
980	2.0	1.9	4.5	3.8	1.5	5.4	4.5	1.0	6.3	5.3	0.4	7.2	6.1	0.1	8.5	7.1
995	1.5	2.1	4.6	3.9	1.6	5.5	4.7	1.1	6.4	5.4	0.5	7.5	6.3	0.2	8.6	7.3
1015	1.0	2.2	4.8	4.0	1.7	5.7	4.8	1.2	6.6	5.6	0.7	7.8	6.6	-	-	-
208 VOLT AND HIGH SPEED DRIVE ACCESSORY																
950	6.0	1.7	4.2	3.6	1.3	5.1	4.3	0.8	6.0	5.1	0.2	6.9	5.8	-	-	-
980	5.0	1.9	4.5	3.8	1.5	5.4	4.5	1.0	6.3	5.3	0.4	7.2	6.1	0.1	8.5	7.1
995	4.5	2.1	4.6	3.9	1.6	5.5	4.7	1.1	6.4	5.4	0.5	7.5	6.3	0.2	8.6	7.3
1025	3.5	2.3	4.9	4.1	1.8	5.8	4.9	1.3	6.7	5.7	0.7	8.0	6.7	-	-	-
1050	2.5	2.5	5.1	4.3	2.0	6.1	5.1	1.4	7.1	6.0	0.9	8.4	7.0	-	-	-
1065	2.0	2.6	5.3	4.4	2.1	6.3	5.3	1.5	7.3	6.2	1.0	8.6	7.2	-	-	-
1100	1.0	2.9	5.6	4.7	2.3	6.8	5.7	1.8	7.9	6.6	-	-	-	-	-	-
230/460 VOLT AND STANDARD DRIVE																
870	6.0**	1.3	3.6	3.0	0.7	4.3	3.7	0.2	5.1	4.3	-	-	-	-	-	-
900	5.0	1.4	3.8	3.2	0.9	4.7	4.0	0.4	5.6	4.7	-	-	-	-	-	-
930	4.0	1.6	4.1	3.4	1.1	5.0	4.2	0.6	5.9	5.0	0.1	6.7	5.7	-	-	-
950	3.5	1.7	4.2	3.6	1.3	5.1	4.3	0.8	6.0	5.1	0.2	6.9	5.8	-	-	-
965	2.5	1.9	4.5	3.8	1.5	5.4	4.5	1.0	6.3	5.3	0.4	7.2	6.1	0.1	8.5	7.1
995	2.0	2.1	4.6	3.9	1.6	5.5	4.7	1.1	6.4	5.4	0.5	7.5	6.3	0.2	8.6	7.3
1015	1.5	2.2	4.8	4.0	1.7	5.7	4.8	1.2	6.6	5.6	0.6	7.8	6.6	-	-	-
1025	1.0	2.3	4.9	4.1	1.8	5.8	4.9	1.3	6.7	5.7	0.7	8.0	6.7	-	-	-
230/460 VOLT AND HIGH SPEED DRIVE ACCESSORY																
950	6.0	1.7	4.2	3.6	1.3	5.1	4.3	0.8	6.0	5.1	0.2	6.9	5.8	-	-	-
980	5.0	1.9	4.5	3.8	1.5	5.4	4.5	1.0	6.3	5.3	0.4	7.2	6.1	0.1	8.5	7.1
995	4.5	2.1	4.6	3.9	1.6	5.5	4.7	1.1	6.4	5.4	0.5	7.5	6.3	0.2	8.6	7.3
1015	4.0	2.2	4.8	4.0	1.7	5.7	4.8	1.2	6.6	5.6	0.6	7.8	6.6	-	-	-
1025	3.5	2.3	4.9	4.1	1.8	5.8	4.9	1.3	6.7	5.7	0.7	8.0	6.7	-	-	-
1050	3.0	2.5	5.1	4.3	2.0	6.1	5.1	1.4	7.1	6.0	0.9	8.4	7.0	-	-	-
1065	2.5	2.6	5.3	4.4	2.1	6.3	5.3	1.5	7.3	6.2	1.0	8.6	7.2	-	-	-
1100	1.5	2.9	5.6	4.7	2.3	6.8	5.7	1.8	7.9	6.6	-	-	-	-	-	-
1120	1.0	3.1	5.8	4.9	2.5	7.0	5.9	1.9	8.3	6.9	-	-	-	-	-	-

NOTES: 1. Blower performance includes a gas-fired heat exchanger, fixed outdoor air, two-inch T/A filters and a dry evaporator coil.

2. Refer to the additional Static Resistances table.

ESP = External Static Pressure available for the supply and return air duct system. All internal unit resistances have been deducted from the total static pressure of the blower.

* Do NOT close the pulley below 1 turn open.

** Factory setting.

TABLE 10 - STATIC RESISTANCES*

EXTERNAL STATIC PRESSURE DROP

DESCRIPTION	RESISTANCE, IWG CFM					
	15 TON			20 TON		
	4500	6000	7200	6000	8000	9400
WET COIL	0.1	0.1	0.1	0.1	0.1	0.1
ECONOMIZER OPTION	0.1	0.1	0.1	0.1	0.1	0.1
HORIZONTAL DUCT CONNECTIONS	0.2	0.3	0.5	0.2	0.3	0.5

*Deduct these resistance values from the available unit ESP values listed in the respective blower performance table except for Horizontal Duct Connections (Shaded). Add these values due to less airflow resistance.

TABLE 11 - POWER EXHAUST PERFORMANCE

MOTOR SPEED	STATIC RESISTANCE OF RETURN DUCTWORK, IWG									
	0.2		0.3		0.4		0.5		0.6	
	CFM	KW	CFM	KW	CFM	KW	CFM	KW	CFM	KW
HIGH*	5250	0.83	4500	0.85	4200	0.88	3750	0.93	3000	0.99
MEDIUM	4900	0.77	3900	0.79	3500	0.82	2900	0.85	-	-
LOW	4400	0.72	3700	0.74	3000	0.78	-	-	-	-

*Factory Setting

Power Exhaust motor is a 3/4 HP, PSC type with sleeve bearings, a 48 frame and inherent protection.

TABLE 12 - BLOWER MOTOR AND DRIVE DATA

MODEL SIZE	DRIVE	BLOWER RANGE (RPM)	MOTOR[1]			ADJUSTABLE MOTOR PULLEY				FIXED BLOWER PULLEY				BELT (NOTCHED)		
			HP	FRAME	EFF. (%)	DESIG-NATION	OUTSIDE DIA. (IN.)	PITCH DIA. (IN.)	BORE (IN.)	DESIG-NATION	OUTSIDE DIA. (IN.)	PITCH DIA. (IN.)	BORE (IN.)	DESIG-NATION	PITCH LENGTH (IN.)	QTY.
15 TON	Stan-dard	850/1065	5	184T	83	1VP56	5.35	4.3-5.3[2]	1-1/8	BK90	8.75	8.4	1	BX70	71.8	1
	High Speed Access	965/1190								BK80	7.75	7.4	1	BX68	69.8	1
20 TON	Stan-dard	870/1025	7.5	213T	89	1VP68	6.75	5.5-6.5[2]	1-3/8	BK120	11.75	11.4	1-3/16	BX83	84.8	1
	High Speed Access	950/1120								BK110	10.75	10.4	1-3/16	BX81	81.8	1

1All motors have a nominal speed of 1800 RPM, a 1.15 service factor and a solid base. They can operate to the limit of their service factor because they are located in the moving air, upstream of any heating device.

2 Do NOT close this pulley below 1 turn open.

OPERATION

COOLING SYSTEM

The cooling section is a complete factory package utilizing an air-cooled condenser. The system is factory-charged with Refrigerant-22.

The compressors are hermetically sealed, internally sprung and base mounted with rubber insulated hold-down bolts.

Compressors have inherent (internal protection. If there is an abnormal temperature rise in compressor, the protector will open to shut down the compressor.

PRELIMINARY OPERATION COOLING

After installation has been completed, energize the crankcase heaters for at lest four hours before operation the unit. After the initial installation, the compressors should be given three false starts (energized just long enough to make a few revolutions with 5-7 minutes delay between each start, before being put into full time service.

COOLING SEQUENCE OF OPERATION

NO OUTDOOR AIR OPTIONS - When the room thermostat calls for “first-stage” cooling, the low voltage control circuit from “R” to “G” and “Y1" is completed to energize compressor #1, condenser fan motor #1, condenser fan motor #2 (if the ambient temperature is above 60°F), and the supply air blower motor (if the fan switch on the room thermostat is set in the ”AUTO" position).

When the thermostat calls for “second-stage” cooling, the low voltage control circuit from “R” to “Y2" is completed to energize compressor #2.

After the thermostat is satisfied and opens, all components will stop simultaneously. The blower motor will continue to operate if the fan switch on the room thermostat is set in the “ON” position.

ECONOMIZER WITH SINGLE ENTHALPY SENSOR - When the room thermostat calls for “first-stage” cooling, the low voltage control circuit from “R” to “G” and “Y1" is completed. The ”R" to “G” circuit energizes the blower motor (if the fan switch on the room thermostat is set in the “AUTO” position) and drives the economizer dampers from fully closed to their minimum position. If the enthalpy of the outdoor air is below the setpoint of the enthalpy controller (previously determined), “Y1" energizes the economizer. The dampers will modulate to maintain a constant supply air temperature as monitored by the discharge air sensor. If the outdoor air enthalpy is above the setpoint, ”Y1" energizes compressor #1, condenser fan motor #1, and condenser fan motor #2 (if the ambient temperature is above 60°F).

When the thermostat calls for “second-stage” cooling, the low voltage control circuit from “R” to “Y2" is completed. If the enthalpy of the outdoor air is below the setpoint of the enthalpy controller (i.e. first stage has energized the economizer), ”Y2" will energize compressor #1. If the outdoor air is above the setpoint, “Y2" will energize compressor #2.

After the thermostat is satisfied and opens, all components will stop simultaneously. The blower motor will continue to operate if the fan switch on the room thermostat is set in the “ON” position.

ECONOMIZER WITH DUAL ENTHALPY SENSORS - The operation with the dual enthalpy sensors is identical to the single sensor except that a second enthalpy sensor is mounted in the return air. This return air sensor allows the economizer to choose between outdoor air and return air, whichever has the lowest enthalpy value, to provide maximum operating efficiency.

ECONOMIZER (SINGLE OR DUAL) WITH POWER EXHAUST - This system operates as specified above with one addition. The power exhaust motor is energized whenever the economizer is chosen by the enthalpy sensor for first stage cooling, “Y1". As always, the ”R" to “G” connection provides minimum position but does not provide power exhaust operation.

MOTORIZED OUTDOOR AIR DAMPERS - This system operation is the same as the units with no outdoor air options with one exception. When the “R” to “G” circuit is complete, the motorized damper drives open to a position set by the thumbwheel on the damper motor. When the “R” to “G” circuit is opened, the damper spring returns fully closed.

CONTINUOUS BLOWER - Continuous blower operation is possible by closing the R to G circuit on the thermostat.

SAFETY CONTROLS

Each refrigerant system is equipped with the following safety controls:

1. A Suction Line Freezestat to protect against low evaporator temperatures due to a low air flow or a low return air temperature. (Opens at 26°F ±5° F and resets at 38°F ± 5°F.)
2. A High Pressure Cutout Switch to protect against excessive discharge pressures due to a blocked condenser coil or a condenser motor failure. (Opens at 380 psig ± 10 and resets at 300 psig ± 10.)
3. A Low Pressure Switch to protect against loss of refrigerant charge. (Opens at 7 psiog ± 3 and resets at 22 psig ± 5.)

If either one of the above safety controls opens, that individual refrigerant system will be locked out. The other refrigerant system will continue in operation unless it too is effected by the same fault. The lock out of either system can be reset by opening the 24V circuit either at the room thermostat or at the unit disconnect.

HEATING SYSTEM

The following sequence describes the operation of the gas heat section.

CONTINUOUS BLOWER

With the room thermostat switch set to “ON”, the supply air blower will operate continuously. The normally closed contact “K5-1" provides 24 volt power to the “3M” contactor. The “3M-1, 2 & 3" power contacts close and the blower motor operates.

INTERMITTENT BLOWER

With the room thermostat system switch set to the “AUTO” or “HEAT” position and the fan switch set to “AUTO”, the supply air blower will operate after the room thermostat calls for heat and the time delay relay closes.

The “TH1" closes, the heat relay ”RW1" is energized. The “RW1-1” power contact closes energizing the line voltage draft motor. The “RW1-2" contact is also closed. As the speed of the draft motor reaches approximately 2500 RPM, the centrifugal switch contact located on the end of the draft motor shaft closes to power the first stage ignition module “IC1”.

Ignition module “IC1" will immediately start the first stage ignitor sparking and will open the redundant valve located inside the first stage main gas valve “GV1” to allow a flow of gas to only the first stage carryover tube. Only after the pilot flame has been ignited and the presence of pilot flame detected at the “IC1” by a signal sent back through the flame sensor is sparking terminated and the first stage main gas valve opened.

Gas flows into each of the main burners and is ignited from the carryover tube flame.

If “IC1” fails to detect a pilot flame, it will continue to try for a maximum of 85 seconds to ignite the pilot tube. If the pilot flame is not detected, then “IC1" will lock out first stage furnace

operation until 24V power is removed from the module either at the unit or by resetting the room thermostat.

At the same time power was supplied to the “RW1”, a parallel circuit activates “ETD” which closes the “ETD” contact after approximately 35 seconds and energizes “K5" which closes ”K5-2" and starts the blower by energizing “3M”.

When “TH2" closes, heat relay ”RW2" is energized. The “RW2-1" contact is closed energizing the second stage ignition module ”IC2". “IC2" will immediately start the second stage ignitor sparking and will open the redundant valve located inside the second stage main gas valve ”GV2" to allow a flow of gas to the second stage carryover tube. Only after the pilot flame has been ignited and the presence of pilot flame detected at “IC2" by a signal sent back through the flame sensor is sparking terminated and the main gas valve opened.

Gas flows into each of the second stage main burners and is ignited from the carryover tube flame.

If “IC2" fails to detect a pilot flame, it will continue to try for a maximum of 85 seconds to ignite the pilot tube. If the pilot flame is not detected, then ”IC2" will lock out first stage furnace operation until 24V power is removed from the module either at the unit or by resetting the room thermostat. *Note that the second stage furnace can operate even if first stage has locked out.*

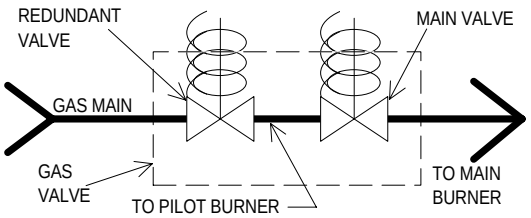

FIG. 12 - GAS VALVE PIPING

When the heating cycle is complete, “TH2" opens de-energizing the ”RW2" then “TH1" opens de-energizing ”RW1" and “ETD”, thus closing all gas valves. The blower motor will continue to run (approximately 45 seconds after the furnace is shut down) until “ETD” opens, de-energizing the “K5" relay and ”3M" contactor.

SAFETY CONTROLS

The control circuit includes the following safety controls:

1. Limit Control (LS). This control is located inside the heat exchanger compartment and is set to open at the temperature indicated in the Limit Control Setting Table. It resets automatically. The limit switch operates when a high temperature condition, caused by inadequate supply air flow occurs, thus shutting down the ignition control and closing the main gas valves and energizing the blower.

2. Centrifugal Switch (CS). If the draft motor should fail, the centrifugal switch attached to the shaft of the motor prevents the ignition controls and gas valves from being energized.

3. Redundant Gas Valve. There are two separate gas valves in the furnace. Each valve contains a main and a redundant valve. The redundant valves are located upstream of the main gas valves. Should either or both of the main gas valves fail in the open position the redundant valves serve as back-ups and shuts off the flow of gas.

4. Flame Sensor Rod / 100% Ignition Control Lock-Out. The flame rods and controls are located per Proper Flame Adjustment figure. If an ignition control fails to detect a signal from the flame sensor indicating the pilot flame is properly ignited, then the main gas valve will not open. It will continue to try and ignite the pilot for a maximum of 85 seconds, then if the pilot flame is not detected, the ignition control will lock out furnace operation until 24V power is removed from the module either at the unit or by resetting the room thermostat.

5. Rollout Switch. This switch is located above the main burners in the control compartment which in the event of a sustained main burner rollout shuts off and locks out both ignition controls closing both gas valves. The ignition controls lock out furnace operation until 24V power is removed from the controls either at the unit or by resetting the room thermostat. *Note the auto reset rollout switch must reset before allowing furnace operation.*

6. Auxiliary limit switch (AUX) - This control is located inside the heat exchanger compartment and is set to open at 190°F. It is a manual reset switch. If AUX trips, then the primary limit has not functioned correctly. Replace the primary limit.

TABLE 13 - LIMIT CONTROL SETTING

Units (Tons)	Capacity, MBH		Limit Control Opens, °F
	Input	Output	
15 & 20	300	240	195
15 & 20	400	320	195

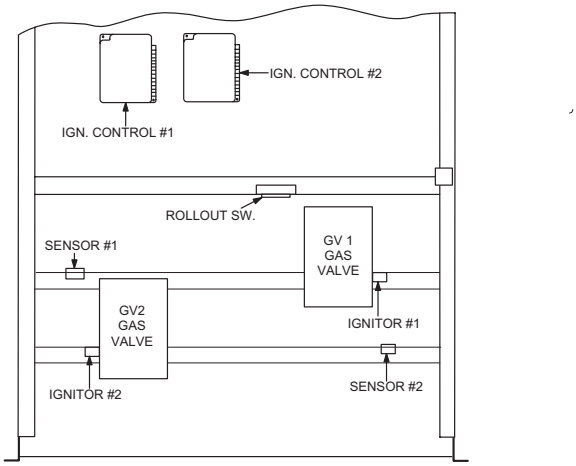

FIG 13-GAS VALVE AND CONTROLS

HEAT ANTICIPATOR SETPOINTS

It is important that the anticipator setpoint be correct. Too high of a setting will result in longer heat cycles and a greater temperature swing in the conditioned space. Reducing the value below the correct setpoint will give shorter “ON” cycles and may result in the lowering of the temperture within the conditioned space.

Gas Valve	Anticipator Setpoint	
	1st Stage	2nd Stage
Honeywell VR8440	0.30 amp	0.11 amp
White-Rodgers 36C68		

START-UP

PRE-START CHECK LIST

Complete the following checks before starting the unit.

1. Check the type of gas being supplied. Be sure that it is the same as listed on the unit nameplate.
2. Make sure that the vent and combustion air hoods have been properly installed.

OPERATING INSTRUCTIONS

CAUTION: This furnace is equipped with an intermittent pilot and automatic re-ignition system. DO NOT attempt to manually light the pilot.

TO LIGHT PILOT AND MAIN BURNERS:

1. Turn “off” electric power to unit.
2. Turn room thermostat to lowest setting.
3. Turn gas valve knob to “on” position.
4. Turn “on” electric power to unit.
5. Set room thermostat to desired temperature. (If thermostat “set” temperature is above room temperature, pilot burner ignition will occur and, after an interval to prove pilot flame, main burners will ignite).

TO SHUT DOWN:

1. Turn “off” electric power to unit.
2. Depress knob of gas valve while turning to “off” position.

POST-START CHECK LIST (GAS)

After the entire control circuit has been energized and the heating section is operating, make the following checks:

1. Check for gas leaks in the unit piping as well as the supply piping.
2. Check for correct manifold gas pressures. See “Checking Gas Input”.
3. Check the supply gas pressure. It must be within the limits shown on rating nameplate. Supply pressure should be checked with all gas appliances in the building at full fire. At no time should the stand by gas line pressure exceed 13 inches, nor the operating pressure drop below 5.0" for natural gas units. If gas pressure is outside these limits, contact the local gas utility for corrective action.

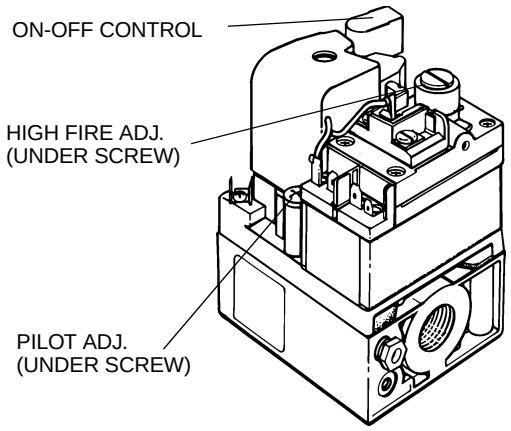

FIG. 14 - TYPICAL GAS VALVE

MANIFOLD GAS PRESSURE ADJUSTMENT

Small adjustments to the high-fire gas flow may be made by turning the pressure regulator adjusting screw on the automatic gas valve.

Adjust as follows:

1. Remove the cap on the regulator. It’s located next to the push-on electrical terminals.
2. To decrease the gas pressure, turn the adjusting screw *counterclockwise.*
3. To increase the gas pressure, turn the adjusting screw *clockwise*.

NOTE: The correct manifold pressure for these furnaces is 3.65 IWG ±0.3.

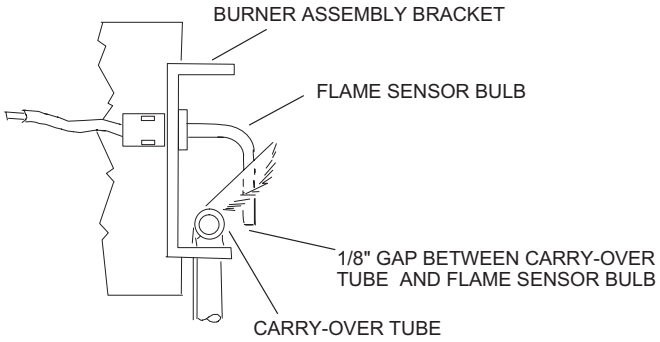

FIG. 15 - PROPER FLAME ADJUSTMENT

PILOT CHECKOUT

The pilot flame should envelope the end of the flame sensor. To adjust pilot flame, (1) remove pilot adjustment cover screw, (2) increase or decrease the clearance for air to the desired level, (3) be sure to replace cover screw after adjustment to prevent possible gas leakage.

Put the system into operation and observe through complete cycle to be sure all controls function properly.

BURNER INSTRUCTIONS

To check or change burners, pilot or orifices, CLOSE MAIN MANUAL SHUT-OFF VALVE AND SHUT OFF ALL ELECTRIC POWER TO THE UNIT.

1. Remove the screws holding either end of the manifold to the burner supports.
2. Open the union fitting in the gas supply line just upstream of the unit gas valve and downstream from the main manual shut-off valve.

3. Remove the gas piping closure panel.

4. Disconnect wiring to the gas valves and spark ignitors. Remove the manifold-burner gas valve assembly by lifting up and pulling back.

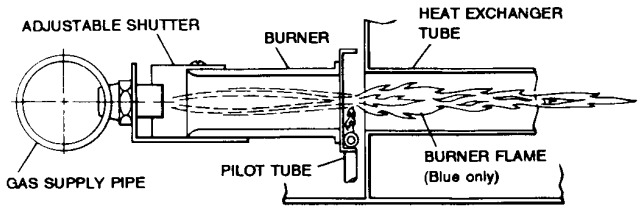

FIG. 16 - TYPICAL FLAME APPEARANCE

Burners are now accessible for service.

Reverse the above procedure to replace the assemblies. Make sure that burners are level and seat at the rear of the heat exchanger.

BURNER AIR SHUTTER ADJUSTMENT

Adjust burner shutters so no yellow flame is observed in the heat exchanger tubes.

CHECKING SUPPLY AIR CFM

The RPM of the supply air blower will depend on the required CFM, the unit accessories or options and the static resistances of both the supply and the return air duct systems. With this information, the RPM for the supply air blower and the motor pulley adjustment (turns open) can be determined from the Blower Performance Data Tables.

High speed drive accessories (containing a smaller blower pulley and a shorter belt) are available for applications requiring the supply air blower to produce higher CFM's and/or higher static pressures. Use Model 1LD0416 for 15 ton units and Model 1LD0417 for 20 ton units. Refer to the Blower Motor and Drive Data Table.

Note the following:

1. The supply air CFM must be within the limitations shown in the Applications Data Table.

2. Pulleys can be adjusted in half turn increments.

3. The tension on the belt should be adjusted as shown in the Belt Adjustment figure.

Start the supply air blower motor. Adjust the resistances in both the supply and the return air duct systems to balance the air distribution throughout the conditioned space. The job specifications may require that this balancing be done by someone other than the equipment installer.

To check the supply air CFM after the initial balancing has been completed:

1. Remove the two 5/16 inch dot plugs from the blower motor and the filter access panels shown in the Dimensions and Clearances figure.

2. Insert at least 8 inches of 1/4 inch tubing into each of these holes for sufficient penetration into the air flow on both sides of the indoor coil.

   NOTE: The tubes must be inserted and held in a position perpendicular to the air flow so that velocity pressure will not affect the static pressure readings.

3. Using an inclined manometer, determine the pressure drop across a dry evaporator coil. Since the moisture on an evaporator coil may vary greatly, measuring the pressure drop across a wet coil under field conditions would be

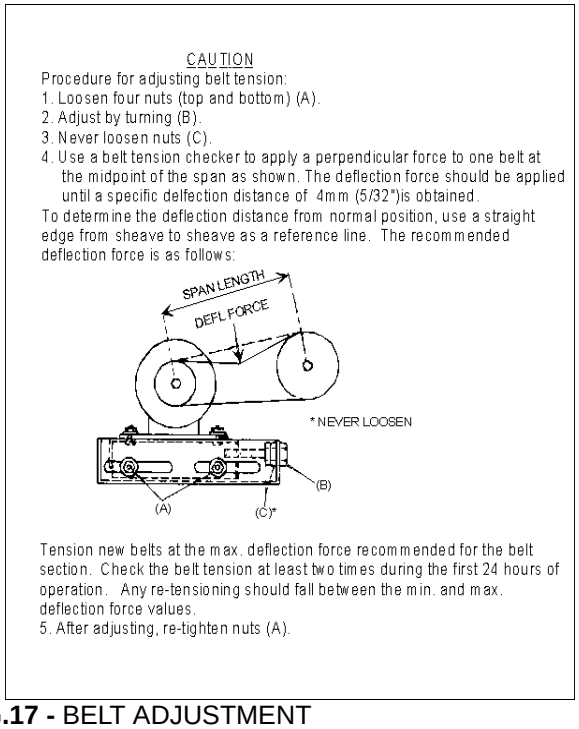
CAUTION
Procedure for adjusting belt tension:
1. Loosen four nuts (top and bottom) (A).
2. Adjust by turning (B).
3. Never loosen nuts (C).
4. Use a belt tension checker to apply a perpendicular force to one belt at the midpoint of the span as shown. The deflection force should be applied until a specific delfection distance of 4mm (5/32")is obtained.
To determine the deflection distance from normal position, use a straight edge from sheave to sheave as a reference line. The recommended deflection force is as follows:
SPAN LENGTH
DEFL FORCE
* NEVER LOOSEN
(B)
(A)
(C)*
Tension new belts at the max. deflection force recommended for the belt section. Check the belt tension at least two times during the first 24 hours of operation. Any re-tensioning should fall between the min. and max. deflection force values.
5. After adjusting, re-tighten nuts (A).

FIG.17 - BELT ADJUSTMENT

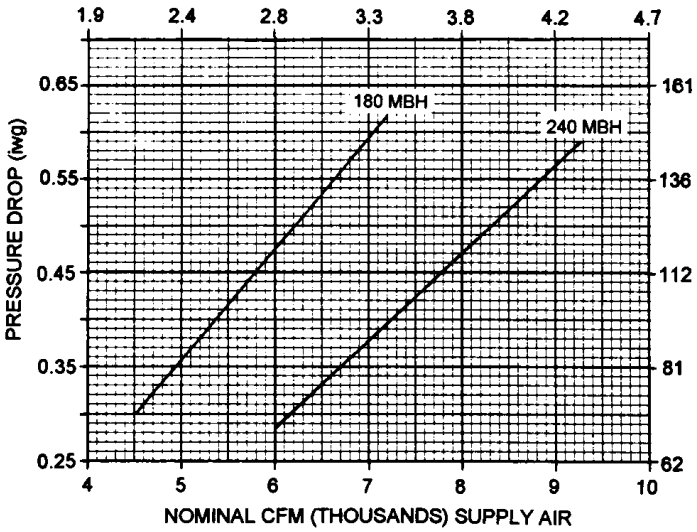

FIG. 18 - PRESSURE DROP ACROSS A DRY INDOOR COIL VS SUPPLY AIR CFM

inaccurate. To assure a dry coil, the compressors should be deactivated while the test is being run.

4. Knowing the pressure drop across a dry coil, the actual CFM through the unit and clean 2 inch filters, can be determined from the curve in Pressure Drop vs. Supply Air CFM figure.

WARNING: Failure to properly adjust the total system air quantity can result in extensive blower damage.

After readings have been obtained, remove the tubes and reinstall the two 5/16 inch dot plugs that were removed in Step 1.

NOTE: DE-ENERGIZE THE COMPRESSORS BEFORE TAKING ANY TEST MEASUREMENTS TO ASSURE A DRY INDOOR COIL.

ADJUSTMENT OF TEMPERATURE RISE

The temperature rise (or temperature difference between the return air and the heated air from the furnace) must lie within the range shown on the ETL rating plate and the data in the Gas Heat Application Table.

$$CFM = \frac{\text{Btuh Input x } 0.8}{1.08 \text{ x } {}^{o}\text{F Temp. Rise}}$$

After the temperature rise has been determined, the cfm can be calculated as follows:

After about 20 minutes of operation, determine the furnace temperature rise. Take readings of both the return air and the heated air in the ducts (about six feet from the furnace) where they will not be affected by radiant heat. Increase the blower cfm to decrease the temperature rise; decrease the blower cfm to increase the rise. Refer to the Blower Motor and Drive Data Table.

BELT DRIVE BLOWER

All units have belt drive single-speed blower motors. The variable pitch pulley on the blower motor can be adjusted to obtain the desired supply air CFM.

CHECKING GAS INPUT

NATURAL GAS

1. Turn off all other gas appliances connected to the gas meter.
2. With the furnace turned on, measure the time needed for one revolution of the hand on the smallest dial on the meter. A typical gas meter usually has a 1/2 or a 1 cubic foot test dial.
3. Using the number of seconds for each revolution and the size of the test dial increment, find the cubic feet of gas consumed per hour from the Gas Rate - Cubic Feet Per Hour Table.

If the actual input is not within 5% of the furnace rating (with allowance being made for the permissible range of the regulator setting), replace the orifice spuds with spuds of the proper size.

NOTE To find the Btu input, multiply the number of cubic feet of gas consumed per hour by the Btu content of the gas in

TABLE 14 - GAS RATE - CUBIC FEET PER HOUR

Seconds for One Rev.	Size of Test Dial	
	1/2 cu. ft.	1 cu. ft.
4	450	900
6	300	600
8	228	450
10	180	360
12	150	300
14	129	257
16	113	225
18	100	200
20	90	180
22	82	164
24	75	150
26	69	138
28	64	129

Example: By actual measurement, it takes 13 seconds for the hand on the 1-cubic foot dial to make a revolution with just a 300,000 Btuh furnace running. Read across to the column in the table above, headed “1 Cubic Foot”, where you will see that 278 cubic feet of gas per hour are consumed by the furnace at that rate. Multiply 278 x 1050 (the Btu rating of the gas obtained from the local gas company). The result is 292,425 Btuh, which is close to the 300,000 Btuh rating of the furnace.

SECURE OWNER’S APPROVAL: *When the system is functioning properly, secure the owner’s approval. Show him the location of all disconnect switches and the thermostat. Teach him how to start and stop the unit and how to adjust temperature settings within the limitations of the system.*

MAINTENANCE

your particular locality (contact your gas company for this information - it varies widely from city to city.)

NORMAL MAINTENANCE

CAUTION: Prior to any of the following maintenance procedures, shut off all electric power to the unit to prevent personal injury.

Periodic maintenance normally consists of changing or cleaning filters and (under some conditions) cleaning the main burners.

FILTERS - Inspect once a month. Replace disposable or clean permanent type as necessary. DO NOT replace permanent type with disposable. The dimensional size of the replacement filter must be the same as the replaced filter.

MOTORS

Outdoor fan motors are permanently lubricated and require no maintenance.

Ventor motor is factory lubricated for an estimated 10 year life.

Indoor Blower Motor and Drive - The indoor blower motor features ball bearings that do not require periodic lubrication. Periodic lubrication of the motor and bearings can extend the life of components but is optional.

CAUTION: *Damage can occur if the bearings are overlubricated. Use grease sparingly.*

WARNING: Perform all maintenance operations on the blower motor with electric power disconnected from the unit. Do not attempt to lubricate bearings with the unit in operation.

On an annual basis, check the motor for accumulations of dust, etc. that may block the cooling slots in the motor shell. Check for loose, damaged or misaligned drive components. Check that all mounting bolts are tight. Replace defective parts as required.

If desired, every three years remove both pipe plugs at each end shell and clean out any hardened grease or foreign matter. Replace one plug on each end with a clean grease fitting. Using a low pressure grease gun, pump grease (Chevron SRI-2 or equivalent) into the bearing cavity until new grease shows at the open port. Do not over lubricate. Run the motor for ten minutes until excess grease is purged from the cavity. Replace the plugs.

On 20 ton only, units are supplied with blower shaft bearings that do not require maintenance but may be relubricated if desired. Every three years, using a low pressure grease gun, pump grease into the bearing grease fitting until grease just begins to show at the seals. Do not over lubricate. Use any lithium base grease recommended for ball bearing service.

OUTDOOR COIL - Dirt should not be allowed to accumulate on the outdoor coil surface or other parts in the air circuit. Cleaning should be as often as necessary to keep coil clean. Use a brush, vacuum cleaner attachment, or other suitable means. If water is used to clean coil, be sure electric power to the unit is shut off prior to cleaning.

NOTE: Exercise care when cleaning the coil so that the coil fins are not damaged.
Do not permit the hot condenser air discharge to be obstructed by overhanging structures of shrubs.

BURNER & PILOT - Periodically (at least annually at the beginning of each heating season) make a visual check of the pilot and main burner flame. If necessary, adjust main burner primary air shutters to give a distinct, sharp blue flame as explained under “BURNER AIR SHUTTER ADJUSTMENT”. If it is not possible to adjust for the proper flame, the burners may need cleaning.

TO CLEAN BURNERS - Remove them from the furnace as explained in “Burner Instructions”. Clean burners with hot water applied along top of the burner.

COMBUSTION AIR DISCHARGE - Visually inspect discharge outlet periodically to make sure that the buildup of soot and dirt is not excessive. If necessary, clean to maintain adequate combustion air discharge.

CLEANING FLUE PASSAGES AND HEATING ELEMENTS

With proper combustion adjustment the heating element of a gas fired furnace will seldom need cleaning. If the element should become sooted, it can be cleaned as follows:

1. Remove the burner assembly as outlined in “BURNER INSTRUCTIONS”.
2. Remove the roof over the gas heat section.
3. At the top plate from the top draft blower housing and the top draft blower wheel.
4. Remove the screws holding the top of the flue collector box. Carefully remove the top of the flue collector box without ripping the adjacent insulation. Then remove the center divider plate separating the upper and lower flue boxes.
5. On the inside of the flue collector box, remove the flue baffles from the tube interiors. Note the last bend of the baffle fits tightly against the tube forcing the end of the baffle to lock into the tube collar. This collar is formed when the tube is expanded into the end sheet. To remove, move the end of the baffle toward the center of the tube releasing the end of the baffle from the tube collar, then pull straight out of the tube. Refer to Typical Flue Baffle figure.
6. Using a wire brush on a flexible wand, brush out the inside of each heat exchanger from the burner inlet and flue outlet ends.
7. Brush out the inside of the flue collector box and the flue baffles.
8. Run the wire brush down the vent hoods from the flue collector end.
9. If soot build-up is particularly bad, remove the vent motor and clean the wheel and housings. Run the wire brush down the flue extentions at the outlet of the vent housings.
10. After brushing is complete, blow all brushed areas with air or nitrogen. Vacuum as needed.
11. Replace parts in the order they were removed in Steps 1 thru 4.
12. When replacing the center and top of the flue collector box, be careful not to tear the adjoining insulation.

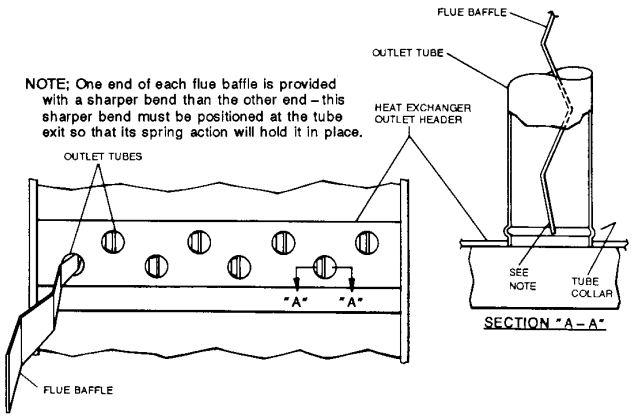
FLUE BAFFLE
OUTLET TUBE
NOTE; One end of each flue baffle is provided with a sharper bend than the other end – this sharper bend must be positioned at the tube exit so that its spring action will hold it in place.
HEAT EXCHANGER OUTLET HEADER
OUTLET TUBES
"A"
"A"
SEE NOTE
TUBE COLLAR
SECTION "A–A"
FLUE BAFFLE

FIG. 19 - TYPICAL FLUE BAFFLE INSTALLATION

TROUBLESHOOTING

13. Ensure that all seams on the vent side of the combustion system are air tight. Apply a high temperature (+500°F) sealing compound where needed.

WARNING: Troubleshooting of components necessarily requires opening the electrical control box with the power connected to the unit. Use extreme care when working with live circuits! Check the unit nameplate for the correct line voltage and set the volt meter to the correct range before making any connections with line terminals.

WARNING: Prior to any of the following maintenance procedures, shut off all electric power to the unit to prevent personal injury.

CAUTION: Label all wires prior to disconnection when servicing controls. Wiring errors can cause improper and dangerous operation. Verify proper operation after servicing.

NOTE To find the Btu input, multiply the number of cubic feet of gas consumed per hour by the Btu content of the gas in your particular locality (contact your gas company for this information - it varies widely from city to city.)

1. The indoor blower motor is a non-inherently protected three-phase motor. Protection is provided by an overload relay for overcurrent and fuses for short circuit. If the motor fails to run, check the line voltage circuit and control voltage circuit per the following procedure:

   a. If the Indoor Blower Motor does not operate, check visually that contactor M3 is pulled in. If so, check for line voltage between all three phases at the line terminals of the Blower Overload Relay (BOR). If line voltage is found, check the leads to the blower motor for open circuit. If line voltage is found at the motor leads (inside the conduit box on the motor shell), disconnect the motor and check for open windings per the motor wiring diagram. If open windings are found, replace the motor. If line voltage is not found at the BOR, trace the leads back to the field supply terminal block, checking for an open circuit or blown fuses.

   b. If the contactor M3 is not pulled in, check for control voltage (24V) at the M3 coil. If voltage is found, replace the contactor. If control voltage is not found at M3, check for voltage across terminals 95 & 96 of the BOR. If voltage exists, the BOR is open on overload. The BOR should be set to the auto reset position. The BOR must cool down in order to reset. If the BOR will not reset, replace the BOR. If the BOR resets and M3 pulls in, but the indoor blower motor will still not run, refer to para. (a) for troubleshooting the line voltage supply circuit. If control voltage is not found at the BOR, trace the circuit back to the relay board and thermostat per the unit wiring diagram. Replace any defective components.

2. Draft motor operates and furnace lights but supply air blower does not start after a short time delay with room thermostat fan switch set to “AUTO”.

   a. Set fan switch to “ON”. If blower motor runs, go to Step f. If it does not, check to see if line voltage is being supplied to the contacts of the contactor (M3), and if the contactor is pulled in. Check for loose wiring.

   b. If contactor (M3) is pulled in, proceed with the troubleshooting steps indicated in Step 1 above.

   c. If (M3) is pulled in and the blower motor still does not run, replace the blower motor.

   d. If (M3) is not pulled in, check for 24 volts at the (M3) coil. If 24 volts is present, replace the (M3) contactor.

   e. If 24 volts is not present at the (M3) coil, check for loose 24 volt wiring back to the relay board. Check control wiring to the room thermostat. If all is fine, replace the relay board.

   f. If the blower motor runs with the fan switch in the “ON” position but does not run soon after the furnace has ignited with the fan switch in the “AUTO” position, check for loose 24 volt wiring between the relay board in the main control box, the Mate-N-Lok connector in the partition between the evaporator and gas heat sections and the time delay relay (ETD).

   g. If all control wiring is fine, check for 24 volts at the relay board. If 24 volts is present, replace the relay board. If 24 volts is not present, replace the (ETD) relay.

NOTE: The furnace may shut itself down on a high temperature condition during the procedure, but this will not effect the test if it is done within 5 minutes of furnace shut-down.

3. The supply air blower operates but the draft motor does not when the room thermostat is set to call for heat and the fan switch in the “ON” position.

   a. The draft motor has inherent protection. If the motor shell is hot to the touch, wait for the internal overload to reset.

   b. If the motor shell is cold with the room thermostat calling for heat, check for line voltage at the motor’s Mate-N-Lok connector attached to the evaporator partition. If line voltage is present, replace the draft motor.

   c. If line voltage is not present, check for line voltage at the heat relay (RW1) contacts in the main control box and check to see if the (RW1) is pulled in.

   d. If the (RW1) relay is pulled in, check for a loose line voltage connection.

   e. If the (RW1) relay is not pulled in, check for 24 volts at the (RW1) coil. If 24 volts is present, replace the (RW1) relay. If 24 volts is not present, check for a loose 24 volt connection back to the relay board and check the connections from the room thermostat to the relay board. If all connections are correct, replace the relay board.

4. The draft motor runs but the furnace does not light and the sparker does not spark.

   a. The ignition control (IC1, IC2) may be locked out due to either a flame roll out or 100% shut off. These safety features are described above. If lock-out has occurred, 24V must be removed from the ignition controls. This is done at the unit or by resetting the room thermostat. After resetting 24V, check for proper furnace operation.

Cont’d.

TROUBLESHOOTING - Cont'd.

If lock-out continues to occur, locate the source of the problem and correct.

b. Check all 24 volt connections from the relay board to and in the gas heat section. Check low voltage connections to the (ETD) located in the control box.

c. If the furnace is hot, it may be out on an over-temperature condition, wait for limit reset.

d. If the furnace is cold, check for 24 volts at wire 241 attached to the electrical time delay (ETD) located in the main control box. If 24 volts is not found, replace the ETD.

e. 24 volts is found at wire 241, remove the wires attached to the (TDR) and with a VOM, check for continuity across contacts 1 and 2. If none is found, the (TDR) is open and must be replaced. If there is continuity, re-attach the wires.With the draft motor running, check for 24 volts at terminal 4 of (RW1-2) and (RW2-1). If 24 volts is not present, the centrifugal switch (CS) has not closed or has gone bad. Check the line voltage to the unit - if it is correct, replace the draft motor. If line voltage is low, call the power company.

f. Check for 24V at terminal 2 of (RW1-2 and RW2-1). If 24V is not present, check for 24V at (RW1 and RW2) relay coils. If these relays are pulled in, then check for a loose connection at terminal 2 and terminal 4 of each relay. If no problem is found, then replace (RW1 and/or RW2) as required.

g. If 24 volts is present at the ignitor controls, check all control wiring at the ignitor controls and the high tension wire to the ignitors. Check that the ground wires from the ignitor controls, the gas valves and pilot burners are all intact and making good electrical connection. Check to make sure that the ceramic insulator on the pilot ignitors or sensors is not broken or cracked, if all are intact, replace the ignition control IC1 or IC2.

5. The draft motor runs and the sparker sparks at the pilot burner but the pilot does not ignite and a gas odor is not detected at the draft motor outlet.

   a. Check to make sure gas is being supplied to the unit. Make sure that the gas pressure to the unit is within the proper limits as described in the "POST START CHECK LIST" and that the pilot adjust screw is allowing some flow of gas as described in "PILOT CHECKOUT".

   b. Check all wiring between the ignitor control and the gas valve. Check to make sure the ground connections are intact.

   c. If the wiring is intact, check for 24 volts across terminals "PV" and "COMMON" on the ignitor control. If 24 volts is not present, replace the ignitor control.

   d. If 24 volts is present, remove the pilot burner and remove the pilot orifice from the pilot burner. The orifice is removed in the direction opposite the flow of gas. Inspect the orifice for obstruction. If it is clear, replace the main gas valve.

6. The sparker sparks at the pilot burner but the pilot does not ignite and a gas odor is detected at the draft motor outlet.

   a. Adjust the pilot adjust screw on the gas valve as described in "PILOT CHECKOUT".

   b. Check the supply pressure as described in "POST START CHECK LIST". Make adjustments as necessary.

   c. Check the pilot orifice for obstruction as described in para. 5d. Clean as needed but the problem should not be the gas valve.

7. The pilot burner ignites but the sparker continues to spark and the main burners do not ignite.

   a. Make the same checks and adjustment as described in para. 6.

   b. Make sure that the pilot burner is not bent or damaged.

   c. Make sure that the ground connections at the pilot burner, gas valve and ignitor control are intact. Check the high tension wire for good electrical connection. If all are intact, replace the ignitor module.

8. The pilot burner lights and the spark stops but the main burners do not light.

   a. Check electrical connections between the ignitor control and the gas valve. If intact, check for 24 volts across terminals "MV" and "COMMON" terminals. If no voltage detected, replace ignitor control. If voltage is present, replace gas valve.

9. Furnace lights with roll-out or one burner has delayed ignition.

   a. Make sure that the pilot burner is aligned properly with the carryover as described in "PILOT CHECKOUT".

   b. Make sure that the carryovers on adjoining burners are screwed fast and are level with respect to one another.

10. Main burners light but exhibit erratic flame characteristics.

    a. Adjust air shutters as described in "BURNER AIR SHUTTER ADJUSTMENT".

    b. Check the main burner orifices for obstruction and alignment. Removal procedure is described in "BURNER INSTRUCTIONS". Clean or replace burner orifices and burners as needed.

REPLACEMENT PARTS

COMPRESSOR SECTION

- Hermetic compressor
- Compressor mounting

MOTOR SECTION

- Blower motor
- Fan motor
- Ventor motor

ELECTRICAL SECTION

- Ignition control
- Relay board
- Contactor
- Circuit breaker
- Temperature controls
- Capacitors
- Relays
- Transformers
- Connectors

GAS HEAT SECTION

- Heat exchanger
- Gas valve
- Pilot
- Flame sensor
- Spark ignitor
- Gas manifold
- Gas burner

AIR MOVING SECTION

- Blower wheel
- Blower wheel housing

REFRIGERANT SECTION

- Evaporator coil
- Evaporator coil header
- Expansion valve assembly
- Condenser coil
- Condenser coil header

FABRICATED PARTS SECTION

- Panels
- Posts
- Covers Drain pans
- Base rails
- Air hoods

MISCELLANEOUS SECTION

- Air inlet hood screen
- Fan guard
- Air filters

TO OBTAIN PARTS INFORMATION: Replacement parts and information from OUR current parts list for this unit are available to your servicing contractor through our local distributor. The name and address of our nearest distributor may be obtained by consulting the Yellow Pages of a local telephone directory.

IMPORTANT: In order to supply the correct part or information from the parts list, our distributor will need to be provided with the complete model number listed on the rating plate located on your unit. See page 2 for Product Nomenclature.

WARNING: IMPROPER INSTALLATION, ADJUSTMENT, SERVICE OR MAINTENANCE CAN CAUSE INJURY OR PROPERTY DAMAGE. CONSULT A QUALIFIED INSTALLER, SERVICE AGENCY OR YOUR LOCAL GAS SUPPLIER FOR INFORMATION OR ASSISTANCE.

YORK®
Heating and Air Conditioning

USA
Proud Sponsor
of the 2000
U.S. Olympic Team

Unitary Products Group
5005 York Drive, Norman, Oklahoma 73069
Subject to change without notice. Printed in U.S.A
Copyright © by York International Corporation 2000. All Rights Reserved.
Supersedes: 530.18-N6Y (1298) Code: SBY 530.18-N6Y(500)